



Level



Pressure



Flow



Temperature



Liquid  
Analysis



Registration



Systems  
Components



Services



Solutions

## Technical Information

# Dosimass

## Coriolis Mass Flow Measuring System For filling applications



### Application

Suitable for use as a mass or volume flowmeter for filling applications.

Liquids with the most diverse properties from the following branches can be measured:

- Food and beverage industry
- Cosmetics industry
- Pharmaceutical industry
- Chemical industry
- Petrochemicals

### Your benefits

- Small size meets the requirements for installation on rotary and linear filling machines
- Highly accurate
- Easy operation via the Endress+Hauser "FieldCare" operating software:
  - Graphic display allows exact analysis and optimisation of the batching process
  - Complete system documentation can be created with device configuration and batching diagram
- 3A-authorized
- CIP, SIP cleaning as well as external cleaning with aggressive media
- No moving parts

## Table of contents

<b>Function and system design</b> .....	<b>3</b>	Material load diagram .....	25
Measuring principle .....	3	Process connection .....	26
Measuring system .....	3		
<b>Input</b> .....	<b>4</b>	<b>Operability</b> .....	<b>26</b>
Measured variable .....	4	Display elements .....	26
Measuring range .....	4	Remote operation .....	26
Operable flow range .....	4		
<b>Output</b> .....	<b>4</b>	<b>Certificates and approvals</b> .....	<b>26</b>
Output signal .....	4	CE mark .....	26
Signal on alarm .....	4	C-tick mark .....	26
Low flow cut off .....	4	Ex approval .....	26
Galvanic isolation .....	4	Sanitary compatibility .....	27
Switching output .....	4	Pressure measuring device approval .....	27
		Other standards and guidelines .....	27
<b>Power supply</b> .....	<b>5</b>	<b>Ordering information</b> .....	<b>27</b>
Electrical connections .....	5	<b>Accessories</b> .....	<b>27</b>
Supply voltage .....	9	<b>Documentation</b> .....	<b>28</b>
Power consumption .....	9	<b>Registered trademarks</b> .....	<b>28</b>
Power supply failure .....	9		
Potential equalisation .....	9		
Cable connection .....	9		
Cable specification .....	9		
<b>Performance characteristics</b> .....	<b>10</b>		
Reference operating conditions .....	10		
Maximum measured error .....	10		
Repeatability .....	10		
Influence of medium temperature .....	10		
Influence of medium pressure .....	10		
<b>Installation</b> .....	<b>11</b>		
Installation instructions .....	11		
Inlet and outlet runs .....	13		
System pressure .....	13		
<b>Environment</b> .....	<b>14</b>		
Ambient temperature range .....	14		
Storage temperature .....	14		
Degree of protection .....	14		
Shock resistance .....	14		
Vibration resistance .....	14		
Electromagnetic compatibility (EMC) .....	14		
<b>Process</b> .....	<b>14</b>		
Medium temperature range .....	14		
Medium pressure range .....	14		
Limiting flow .....	14		
Pressure loss (SI units) .....	15		
Pressure loss (US units) .....	15		
<b>Mechanical construction</b> .....	<b>16</b>		
Design / dimensions .....	16		
Weight .....	24		
Material .....	24		

## Function and system design

### Measuring principle

The measuring principle is based on the controlled generation of Coriolis forces. These forces are always present when both translational and rotational movements are superimposed.

$$F_C = 2 \cdot \Delta m (v \cdot \omega)$$

$F_C$  = Coriolis force

$\Delta m$  = moving mass


$\omega$  = rotational velocity

$v$  = radial velocity in rotating or oscillating system

The amplitude of the Coriolis force depends on the moving mass  $\Delta m$ , its velocity  $v$  in the system, and thus on the mass flow. Instead of a constant angular velocity  $\omega$ , the Promass sensor uses oscillation.

In the sensor, two parallel measuring tubes containing flowing fluid oscillate in antiphase, acting like a tuning fork. The Coriolis forces produced at the measuring tubes cause a phase shift in the tube oscillations (see illustration):

- At zero flow, in other words when the fluid is at a standstill, the two tubes oscillate in phase (1).
- Mass flow causes deceleration of the oscillation at the inlet of the tubes (2) and acceleration at the outlet (3).

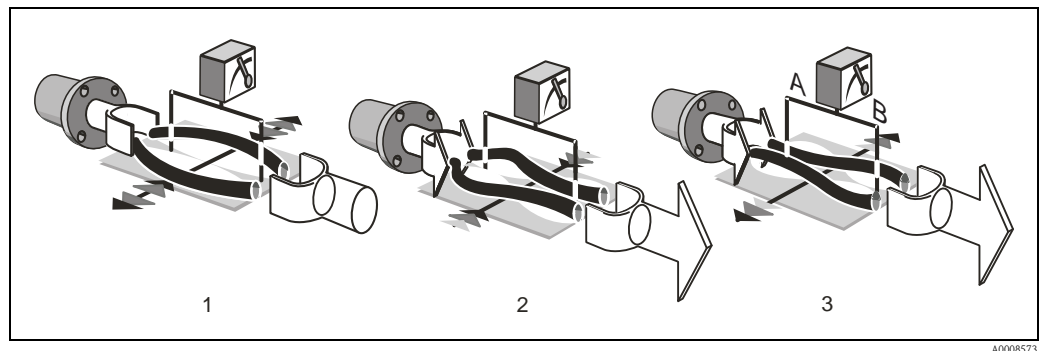

A0008573

The phase difference (A-B) increases with increasing mass flow. Electrodynamic sensors register the tube oscillations at the inlet and outlet.

System balance is ensured by the antiphase oscillation of the two measuring tubes. The measuring principle operates independently of temperature, pressure, viscosity, conductivity and flow profile.

### Density measurement

The measuring tubes are continuously excited at their resonance frequency. A change in the mass and thus the density of the oscillating system (comprising measuring tubes and fluid) results in a corresponding, automatic adjustment in the oscillation frequency. Resonance frequency is thus a function of fluid density.

The microprocessor utilises this relationship to obtain a density signal.

### Temperature measurement

The temperature of the measuring tubes is determined in order to calculate the compensation factor due to temperature effects. This signal corresponds to the process temperature and is also available as an output.

### Measuring system

The measuring system is a compact unit consisting of a sensor and transmitter.

## Input

### Measured variable

- Mass flow (proportional to the phase difference between two sensors mounted on the measuring tube to register a phase shift in the oscillation)
- Volume flow (calculated from mass flow and density)
- Fluid Density (proportional to resonance frequency of the measuring tube)
- Fluid temperature (measured with temperature sensors)

### Measuring range

DN		Range for full scale values (liquids) $\dot{m}_{\min}$ to $\dot{m}_{\max}$	
[mm]	[inch]	[kg/h]	[lb/min]
08	3/8"	0 to 2000	0 to 74
15	1/2"	0 to 6500	0 to 239
25	1"	0 to 18000	0 to 662

Select nominal diameter by optimising between required flow range and permissible pressure loss (→ 15).

- The minimum recommended full scale value is approx. 1/20 of the maximum full scale value.
- In most applications, 20 to 50% of the maximum full scale value can be considered ideal.
- Select a lower full scale value for abrasive substances such as fluids with entrained solids (flow velocity < 1 m/s (3.28 ft/s)).

### Operable flow range

Greater than 1000 :l

Flows above the preset full scale value do not overload the amplifier, i.e. totalized flow values are registered correctly.

## Output

### Output signal

Pulse output:  
Passive, max. 30 VDC/25 mA, pulse value and pulse polarity can be selected, pulse width adjustable (0.05 ms to 1 s).



Note!

The device may only be connected to SELV, PELV or CLASS 2 circuits.

### Signal on alarm

Pulse output → behaviour can be selected  
Transistor status output not conducting in the event of a fault/notice (depending on setting) or if the power supply fails.

### Low flow cut off

Switch point for low flow cut off selectable.

### Galvanic isolation

The power supply and outputs are galvanically isolated from one another.

### Switching output

Status output:  
Passive, max. 30 VDC/25 mA



Note!

The device may only be connected to SELV, PELV or CLASS 2 circuits.

## Power supply

### Electrical connections


#### Direct connection without adapter

The direct electrical connection of the device is established using a Lumberg connector (type RSE8, M12 × 1).



Note!

For the direct connection without adapter, an appropriate cable without continuation of the service interface has to be used, e.g. cable RKWTN8-56/5 P92, Lumberg.

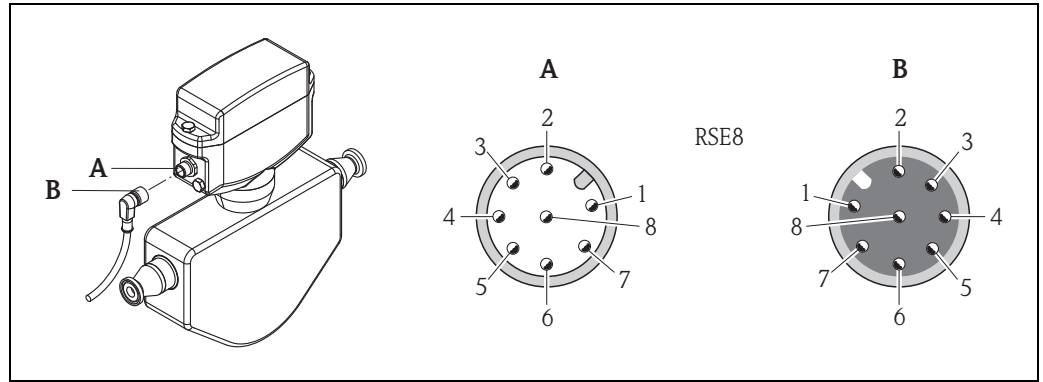

Wiring diagram of the direct connection without adapter

A Socket at device

B Cable connector

1 (+), power supply (24 VDC nominal voltage (20 to 30 VDC), 4.3 W)

4 (-), power supply (24 VDC nominal voltage (20 to 30 VDC), 4.3 W)

5 (+), pulse, status output (max. 30 V)

6 (-), pulse output (max. 25 mA)


7 (-), status output (max. 25 mA)

2 Service interface (may not be connected during normal operation)

3 Service interface (may not be connected during normal operation)


8 Service interface (may not be connected during normal operation)

# Connection with adapter 8 → 8pole (power supply, pulse output, status output)

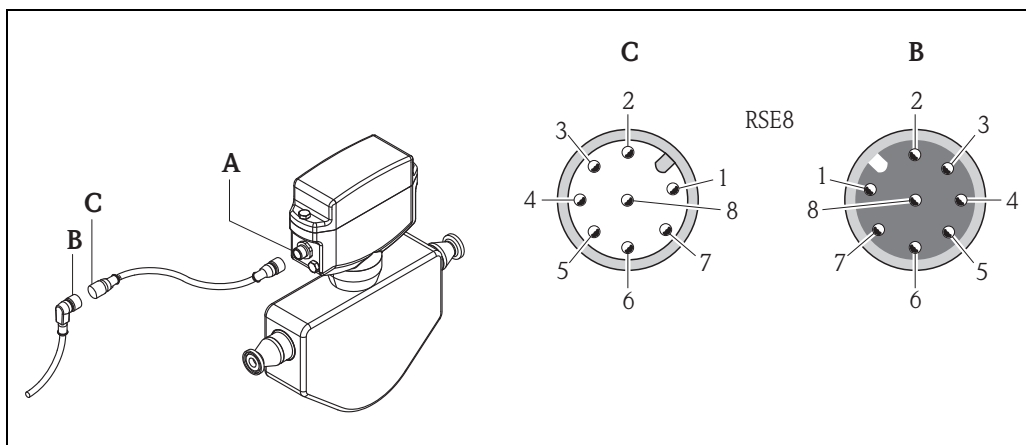

Wiring diagram with adapter 8 → 8pole

- A Socket at device
- B Cable connector
- C Adapter
- 1 (+), power supply (24 VDC nominal voltage (20 to 30 VDC), 4.3 W)
- 4 (-), power supply (24 VDC nominal voltage (20 to 30 VDC), 4.3 W)
- 5 (+), pulse, status output (max. 30 V)
- 6 (-), pulse output (max. 25 mA)
- 7 (-), status output (max. 25 mA)
- 2 Unconnected
- 3 Unconnected
- 8 Unconnected

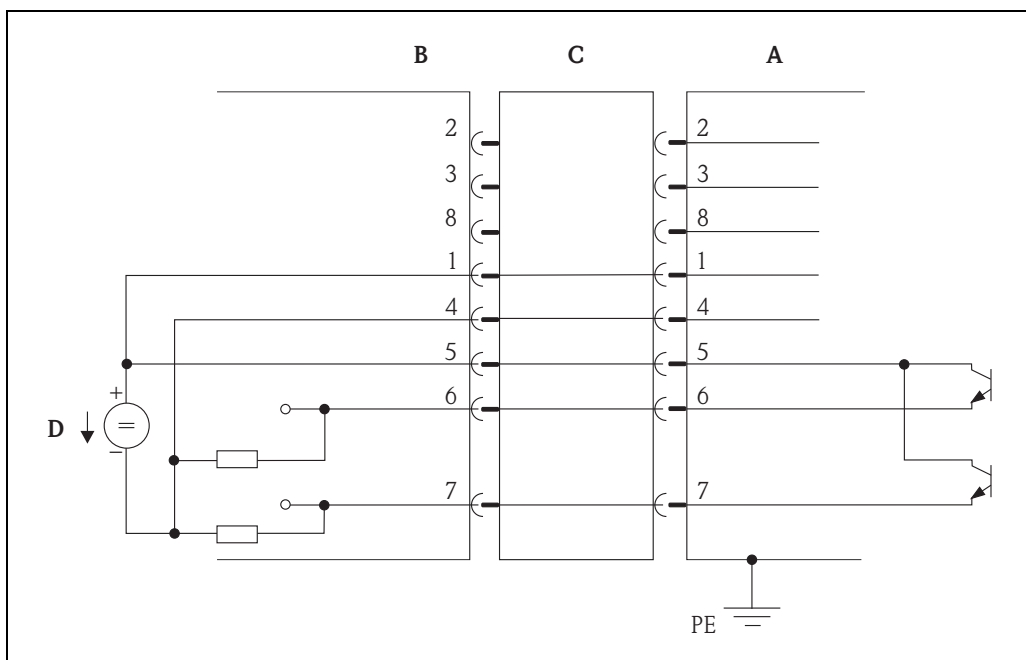


Connection example with adapter 8 → 8pole (Adapter RSE8, 50107169)

- A Socket at device
- B Cable connector
- C Adapter
- D PELV or SELV power supply


Contact assignment → Wiring diagram with adapter 8 → 8pole

# Connection with adapter 8 → 5pole (power supply, pulse output, status output)

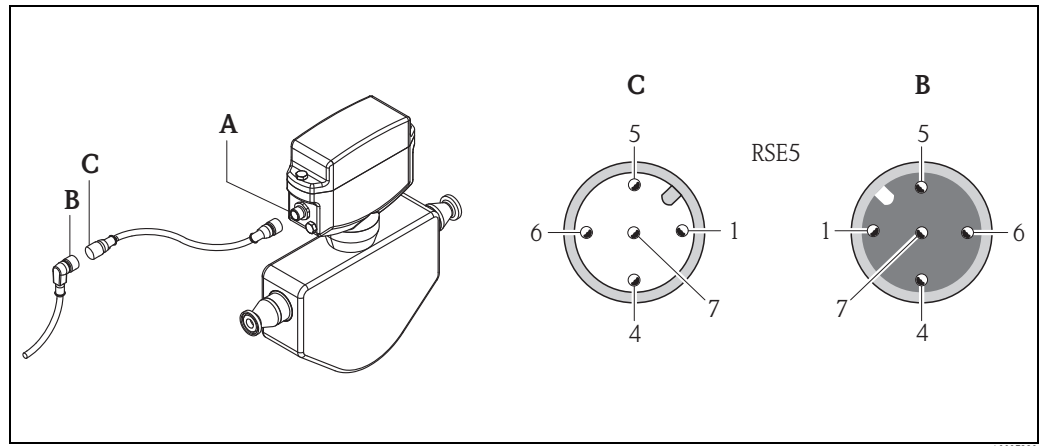

Wiring diagram with adapter 8 → 5pole

- A Socket at device
- B Cable connector
- C Adapter
- 1 (+), power supply (24 VDC nominal voltage (20 to 30 VDC), 4.3 W)
- 4 (-), power supply (24 VDC nominal voltage (20 to 30 VDC), 4.3 W)
- 5 (+), pulse, status output (max. 30 V)
- 6 (-), pulse output (max. 25 mA)
- 7 (-), status output (max. 25 mA)

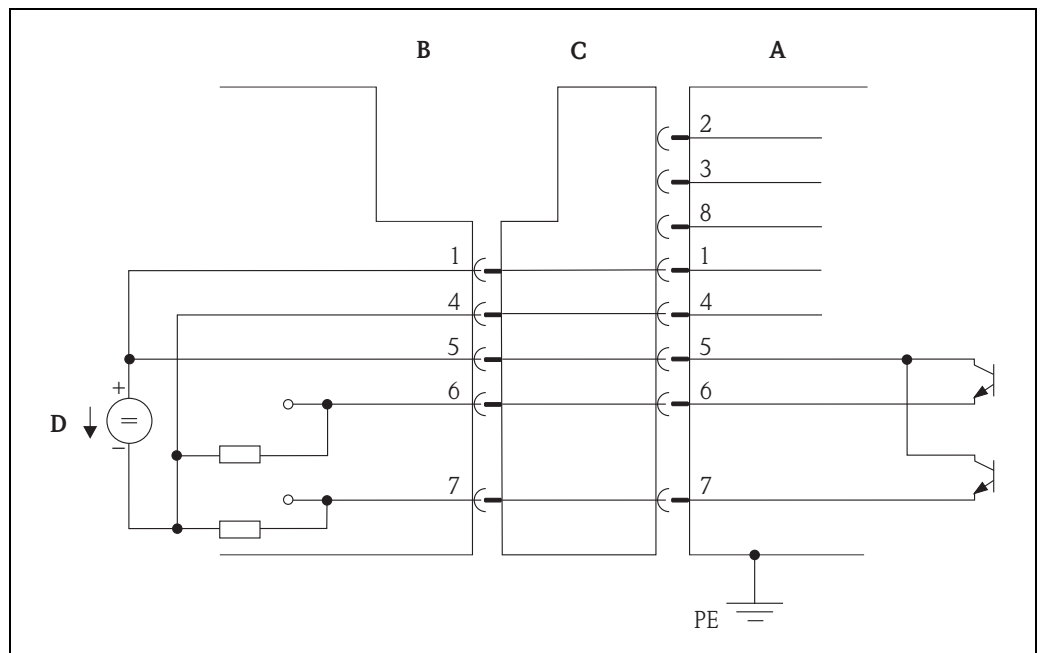


Connection example with adapter 8 → 5pole (Adapter RSE5, 50107168)

- A Socket at device
- B Cable connector
- C Adapter
- D PELV or SELV power supply

Contact assignment → Wiring diagram with adapter 8 → 5pole


### Connection with adapter 8 → 4pole (power supply, pulse output)

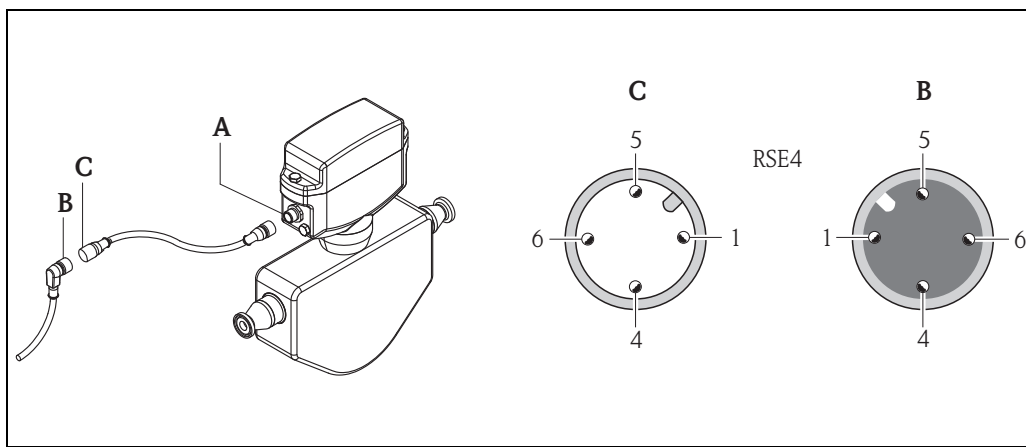

A0007239

#### Wiring diagram with adapter 8 → 4pole

- A** Socket at device  
**B** Cable connector  
**C** Adapter  
**1** (+), power supply (24 VDC nominal voltage (20 to 30 VDC), 4.3 W)  
**4** (-), power supply (24 VDC nominal voltage (20 to 30 VDC), 4.3 W)  
**5** (+), pulse, status output (max. 30 V)  
**6** (-), pulse output (max. 25 mA)

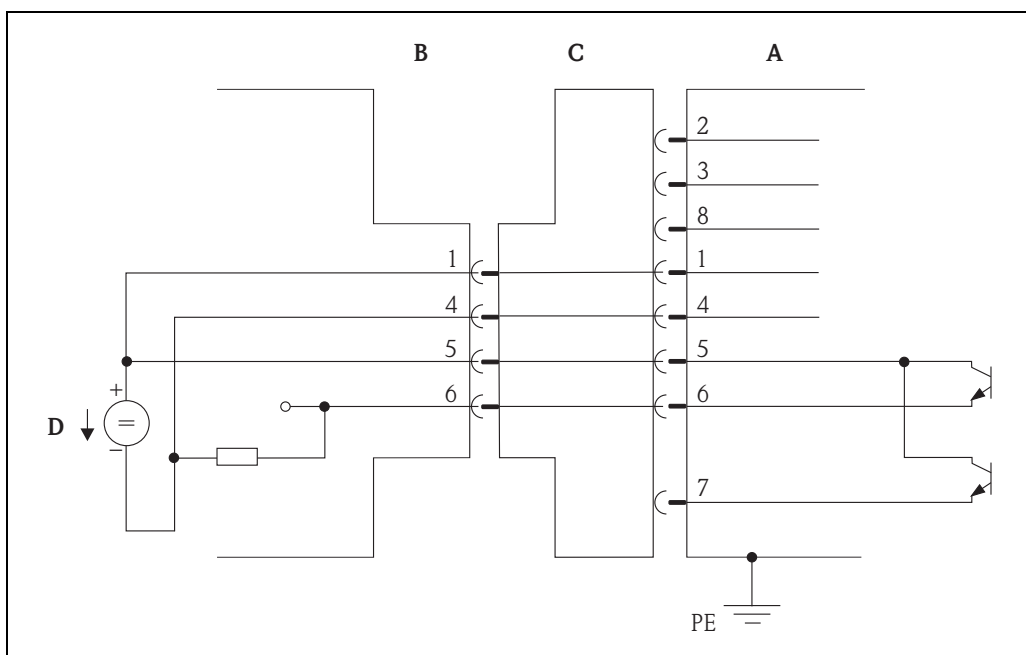

A0003837

#### Connection example with adapter 8 → 4pole (Adapter RSE4, 50107167)


- A** Socket at device  
**B** Cable connector  
**C** Adapter  
**D** PELV or SELV power supply

Contact assignment → Wiring diagram with adapter 8 → 4pole



### Ground connection

The ground connection is established via a cable lug.

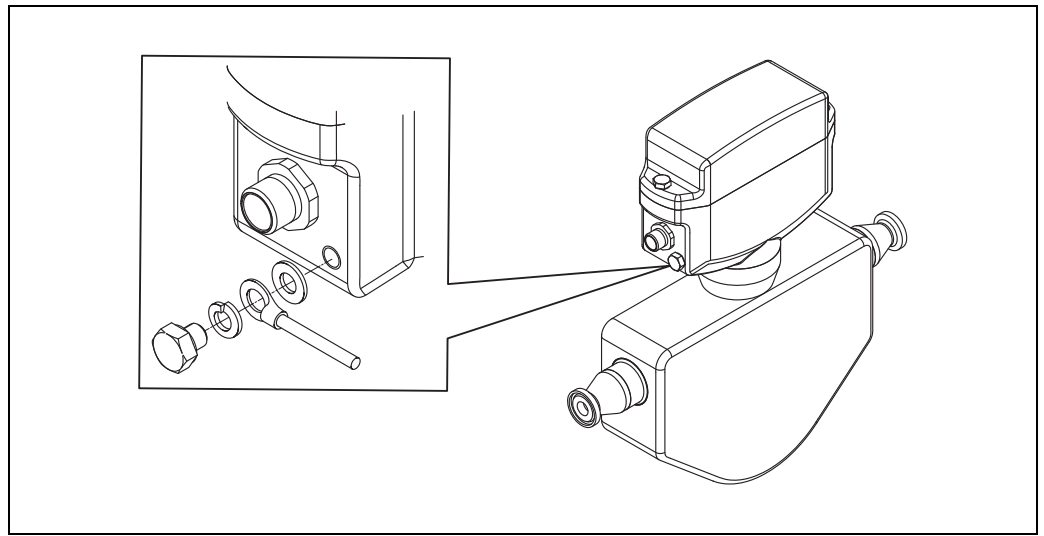

*Dosimass ground connection*

A0007235

### Supply voltage



24 VDC nominal voltage (20 to 30 VDC)

Note!

- The power supply may not exceed a maximum short-circuit current of 50 A.
- The device may only be connected to SELV, PELV or CLASS 2 circuits.

### Power consumption

max. 4.3 W

Switch-on current: max. 1 A (< 6 ms)

### Power supply failure

Lasting min. 20 ms:

all sensor and measuring point data remain in the DAT memory module

### Potential equalisation

No special measures for potential equalization are required. For instruments for use in hazardous areas, observe the corresponding guidelines in the specific Ex documentation.

### Cable connection

Lumberg plug (RSE8, M12 × 1) for power supply and signal outputs

### Cable specification

Every suitable cable with a temperature specification at least 20 °C (68 °F) higher than the ambient temperature in the application. We recommend you use a cable with a temperature specification of +80 °C (+176 °F).

## Performance characteristics

### Reference operating conditions

- Error limits following ISO/DIS 11631
- Water with +15 to +45 °C (+59 to +113 °F) at 2 to 6 bar (29 to 87 psi)
- Specifications as per calibration protocol  $\pm 5$  °C ( $\pm 9$  °F) and  $\pm 2$  bar ( $\pm 29$  psi)
- Accuracy based on accredited calibration rigs that are traced to ISO 17025

### Maximum measured error

o.r. = of reading;  $1 \text{ g/cm}^3 = 1 \text{ kg/l}$

Mass flow (depends on the calibration):

$\pm 0.15\%$  o.r. (1 to 4 m/s (3.28 to 13.1 ft/s))

or

$\pm 0.3\% \pm [(\text{zero point stability} : \text{measured value}) \cdot 100]\%$  o.r.

or

$\pm 5\% \pm [(\text{zero point stability} : \text{measured value}) \cdot 100]\%$  o.r.

Density (liquids):

Reference conditions

- $\pm 0.0005 \text{ g/cm}^3$


Field density calibration <sup>(1)</sup>

- $\pm 0.0005 \text{ g/cm}^3$

Standard density calibration <sup>(2)</sup>

- $\pm 0.02 \text{ g/cm}^3$

<sup>(1)</sup> After on-site field density calibration under process reference conditions

<sup>(2)</sup> Performed on all sensors, valid over entire medium temperature and density range (→  14)

Zero point stability:

DN		Max. full scale value		Zero point stability	
[mm]	[inch]	[kg/h]	[lb/min]	[kg/h]	[lb/min]
08	3/8"	2000	74	0.20	0.0074
15	1/2"	6500	239	0.65	0.0239
25	1"	18000	662	1.8	0.0662

Calculation example:

Give that: Dosimass DN 15, flow = 1300 kg/h (47.8 lb/min)

Measured error:  $\pm 0.3\% \pm [(\text{zero point stability} : \text{measured value}) \cdot 100]\%$  o.r.

Measured error:  $\pm 0.3\% \pm (0.65 \text{ kg/h} : 1300 \text{ kg/h}) \cdot 100\% = \pm 0.35\%$

$\pm 0.3\% \pm (0.0239 \text{ lb/min} : 47.8 \text{ lb/min}) \cdot 100\% = \pm 0.35\%$

### Repeatability

Dosing time [s]	Standard deviation [%]
$\geq 0.75$	0.2
$\geq 1.5$	0.1
$\geq 3.0$	0.05

Density (liquids):  $\pm 0.00025 \text{ g/cm}^3$

### Influence of medium temperature

When there is a difference between the temperature for zero point adjustment and the process temperature, the typical measured error is  $\pm 0.0003\%$  of the full scale value/°C.

### Influence of medium pressure

The effect of a difference in pressure between the calibration pressure and the process pressure on the measured error for mass flow is negligible.


# Installation

## Installation instructions

- Note the following points:
- No special measures such as supports are necessary. External forces are absorbed by the construction of the instrument.
  - The high oscillation frequency of the measuring tubes ensures that the correct operation of the measuring system is not influenced by plant vibrations.
  - No special precautions need to be taken for fittings which create turbulence (valves, elbows, Tpieces, etc.), as long as no cavitation occurs.


## Mounting location

- Correct measurement is only possible if the pipe is filled. **For this reason, avoid** the following mounting locations in the pipe:
- At the highest point of the pipeline. Risk of air accumulating!
  - Directly upstream of a free pipe outlet in a down pipe.

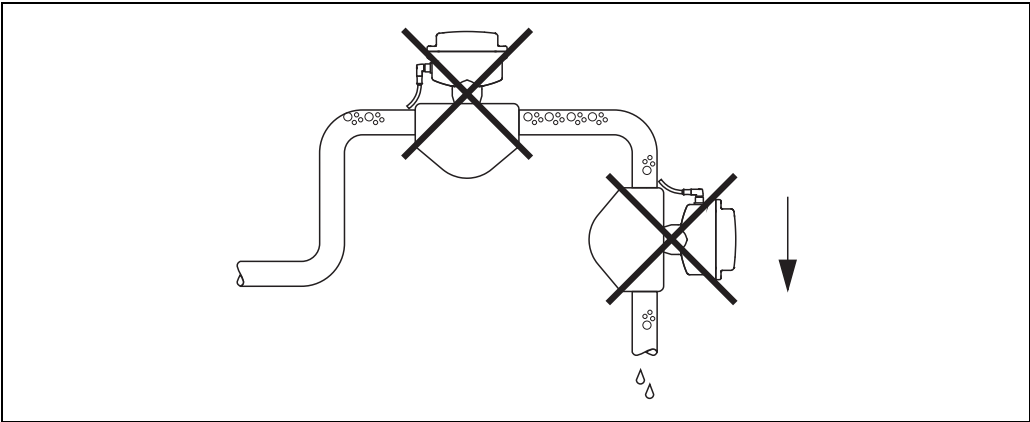

A0008506

The following proposed installation, however, permits installation in an open down pipe. Pipe restrictors or the use of an orifice with a cross-section smaller than the nominal diameter prevent the pipe from running empty during measurement.

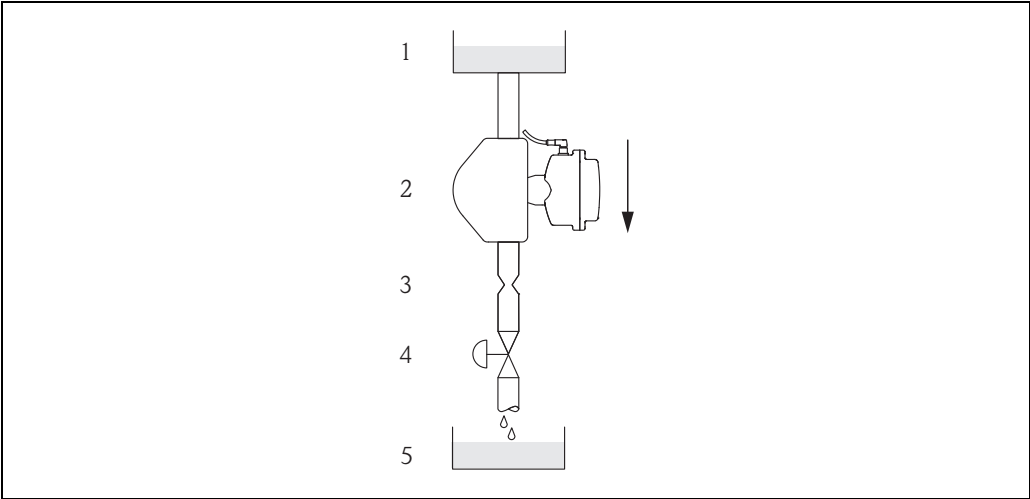

A0008505

Installation in a down pipe (e.g. for batching applications)  
1 = Supply tank, 2 = Sensor, 3 = Orifice plate, pipe restriction, 4 = Valve, 5 = Batching tank

Dosimass / DN	8 (3/8")	15 (1/2")	25 (1")
Ø Orifice plate, pipe restriction	6 mm (0.24 in)	10 mm (0.39 in)	14 mm (0.55 in)


## Orientation

### Vertical Orientation (View 1):

Recommended orientation with upward direction of flow. When fluid is not flowing, entrained solids will sink down and gases will rise away from the measuring tube. The measuring tubes can be completely drained and protected against solids build-up.

### Horizontal Orientation (View 2, 3):

The measuring tubes of Dosimass must be horizontal and beside each other. When installation is correct, the transmitter housing is above or below the pipe. Always avoid having the transmitter housing in a lateral position.

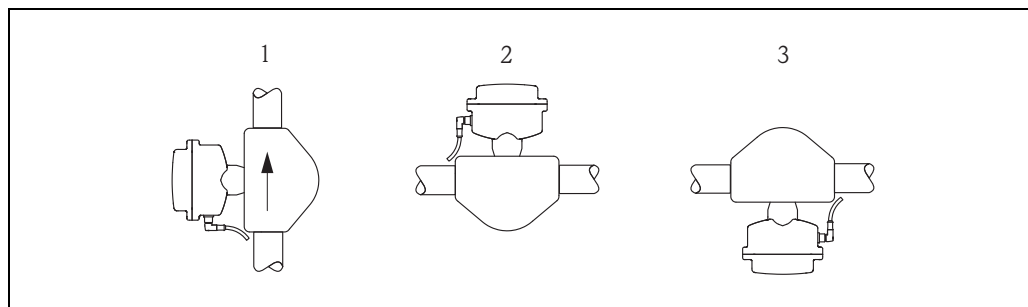

A0008557

### Fluid temperature



#### Caution!

Hot surface temperatures can arise at the housing of the device if fluid temperatures are  $> 70\text{ °C}$  ( $158\text{ °F}$ ).

In order to ensure that the maximum permissible ambient temperature for the transmitter ( $-20\text{ to }+60\text{ °C}$  /  $-4\text{ to }+140\text{ °F}$ ) is not exceeded, we recommend the following orientations:


- High fluid temperature
  - Vertical piping: installation in accordance with View 1
  - Horizontal piping: installation in accordance with View 3
- Low fluid temperature
  - Vertical piping: installation in accordance with View 1
  - Horizontal piping: installation in accordance with View 2

### Fluid properties



#### Caution!

The measuring tubes of Dosimass are slightly curved. The position of the sensor, therefore, has to be matched to the fluid properties when the sensor is installed horizontally.

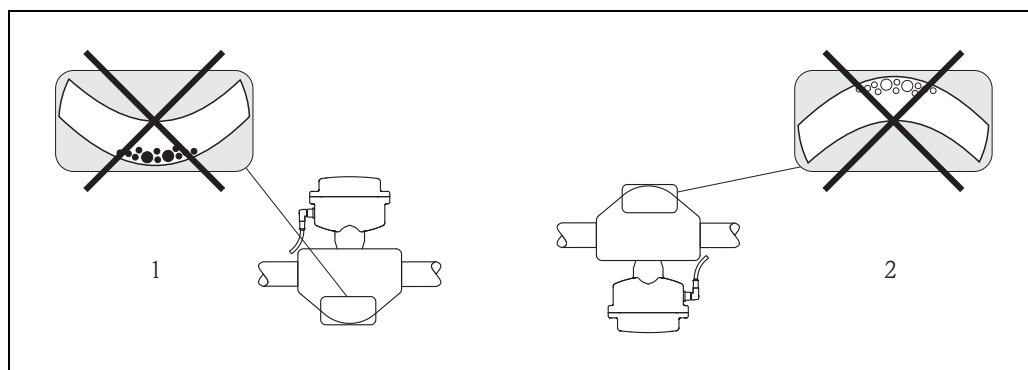

A0008609

- 1 Not suitable for fluids with entrained solids. Risk of solids accumulating.
- 2 Not suitable for outgassing fluids. Risk of air accumulating.

### Heating, heating insulation

Some fluids require suitable measures to avoid loss of heat or heat supply at the sensor. A wide range of materials can be used to provide the required thermal insulation. Heating can be electric, e.g. with electric band heaters, or by means of hot water or steam pipes made of copper.



Caution!

Risk of electronics overheating!

- Consequently, make sure that the adapter between sensor and transmitter always remains free of insulating material. Note that a certain orientation might be required, depending on the fluid temperature (→ 12).
- For information on the permitted ambient air temperature ranges → 14

### Zero point adjustment

All devices are calibrated to state-of-the-art technology. The zero point determined in this way is imprinted on the nameplate. Calibration takes place under reference conditions → 10.

For this reason, the measure generally does not require zero point adjustment!


Experience shows that the zero point adjustment is advisable only in special cases:

- To achieve highest measuring accuracy also with very small flow rates.
- Under extreme process or operating conditions (e.g. very high process temperatures or very high-viscosity fluids).

A zero point adjustment can be performed only with fluids that contain no gas or solid contents.

A zero point adjustment is performed with the measuring tubes completely filled and at zero flow ( $v = 0$  m/s). This can be achieved, for example, with shut-off valves upstream and/or downstream of the sensor or by using existing valves and gates.

- Normal operation → valves 1 and 2 open
- Zero point adjustment *with* pump pressure → valve 1 open / valve 2 closed
- Zero point adjustment *without* pump pressure → valve 1 closed / valve 2 open

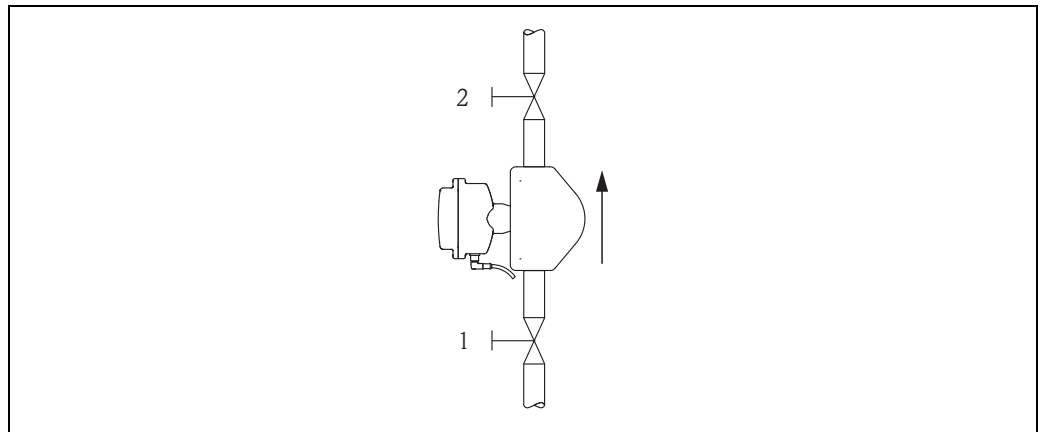

A0008558

### Inlet and outlet runs

There are no installation requirements regarding inlet and outlet runs.

### System pressure

It is important to ensure that cavitation does not occur because it would influence the oscillation of the measuring tube. No special measures need to be taken for fluids which have properties similar to water under normal conditions.

In the case of liquids with a low boiling point (hydrocarbons, solvents, liquefied gases) or in suction lines, it is important to ensure that pressure does not drop below the vapour pressure and that the liquid does not start to boil. It is also important to ensure that the gases that occur naturally in many liquids do not outgas. Such effects can be prevented when system pressure is sufficiently high.


Consequently, it is generally best to install the sensor:

- downstream from pumps (no danger of vacuum),
- at the lowest point in an ascending pipeline.

## Environment

<b>Ambient temperature range</b>	–20 to +60 °C (–4 to +140 °F) (sensor, transmitter) Install the device at a shady location. Avoid direct sunlight, particularly in warm climatic regions.
<b>Storage temperature</b>	–40 to +80 °C (–40 to +176 °F) (preferably +20 °C (+68 °F))
<b>Degree of protection</b>	Standard: IP 67 (NEMA 4X) for transmitter and sensor
<b>Shock resistance</b>	In accordance with IEC 68-2-31
<b>Vibration resistance</b>	Acceleration up to 1 g, 10 to 150 Hz, following IEC 68-2-6
<b>Electromagnetic compatibility (EMC)</b>	To IEC/EN 61326 and NAMUR Recommendation NE 21

## Process

<b>Medium temperature range</b>	Sensor: ■ –40 to +125 °C (–40 to +257 °F)  CIP/SIP cleaning (< 60 min): ■ +150 °C (+302 °F)  Seals: ■ no internal seals  Medium density: ■ 0 to 5000 kg/m <sup>3</sup> (0 to 312 lb/cf)
<b>Medium pressure range</b>	Max. 100 bar (1450 psi), depending on process connection
<b>Limiting flow</b>	→  4, measuring range


### Pressure loss (SI units)

Pressure loss depends on the fluid properties and on the flow rate. The following formulas can be used to approximately calculate the pressure loss:

Reynolds number	$Re = \frac{2 \cdot \dot{m}}{\pi \cdot d \cdot \nu \cdot \rho}$
$Re \geq 2300$	$\Delta p = K \cdot \nu^{0.25} \cdot \dot{m}^{1.85} \cdot \rho^{-0.86}$
$Re < 2300$	$\Delta p = K1 \cdot \nu \cdot \dot{m} + \frac{K2 \cdot \nu^{0.25} \cdot \dot{m}^2}{\rho}$
$\Delta p$ = pressure loss [mbar] $\nu$ = kinematic viscosity [m <sup>2</sup> /s] $\dot{m}$ = mass flow [kg/s]	$\rho$ = density [kg/m <sup>3</sup> ] $d$ = inside diameter of measuring tubes [m] $K$ to $K2$ = constants (depending on nominal diameter)

Pressure loss coefficients:

DN	d [m]	K	K1	K2
8	$5.35 \cdot 10^{-3}$	$5.70 \cdot 10^7$	$7.91 \cdot 10^7$	$2.10 \cdot 10^7$
15	$8.30 \cdot 10^{-3}$	$7.62 \cdot 10^6$	$1.73 \cdot 10^7$	$2.13 \cdot 10^6$
25	$12.00 \cdot 10^{-3}$	$1.89 \cdot 10^6$	$4.66 \cdot 10^6$	$6.11 \cdot 10^5$
Pressure loss data including interface between measuring tubes and piping				

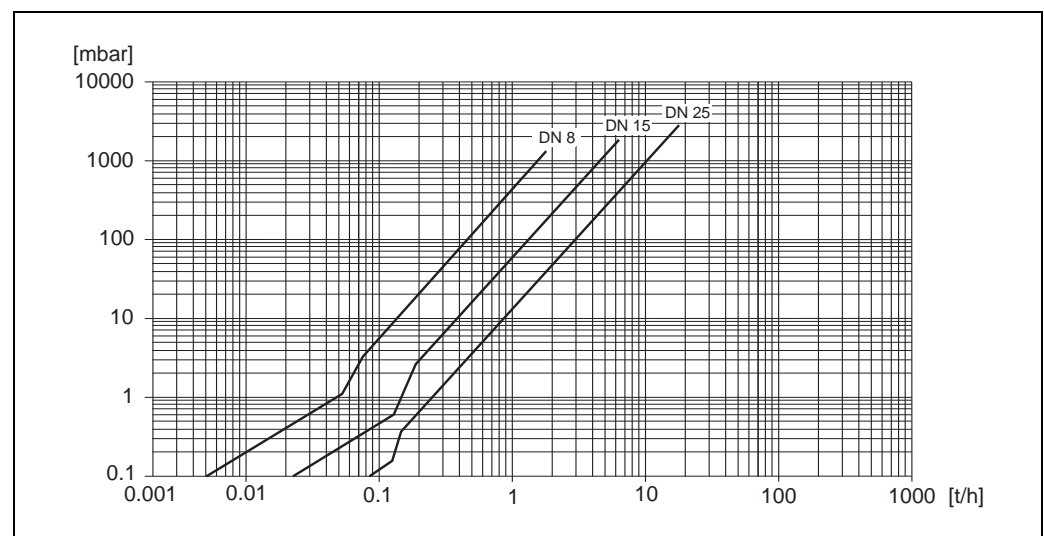

Pressure loss diagram with water

A0008556

### Pressure loss (US units)

Pressure loss is dependent on fluid properties nominal diameter. Consult Endress+Hauser for Applicator PC software to determine pressure loss in US units. All important instrument data is contained in the Applicator software program in order to optimize the design of measuring system. The software is used for following calculations:

- Nominal diameter of the sensor with fluid characteristics such as viscosity, density, etc.
- Pressure loss downstream of the measuring point.
- Converting mass flow to volume flow, etc.
- Simultaneous display of various meter size.
- Determining measuring ranges.


The Applicator runs on any IBM compatible PC with windows.

## Mechanical construction

### Design / dimensions

Dimensions	
Dosimass dimensions	→ 16
Dosimass dimensions: Tri-Clamp connections	→ 17
Dosimass dimensions: Flange connections EN (DIN)	→ 19
Dosimass dimensions: DIN 32676 (clamp)	→ 20
Dosimass dimensions: DIN 11851 connections (sanitary connection)	→ 21
Dosimass dimensions: DIN 11864-1 Form A (threaded joint)	→ 22
Dosimass dimensions : ISO 2853 connections (threaded connection)	→ 23
Dosimass dimensions: SMS 1145 connections (sanitary connection)	→ 24

### Dosimass dimensions

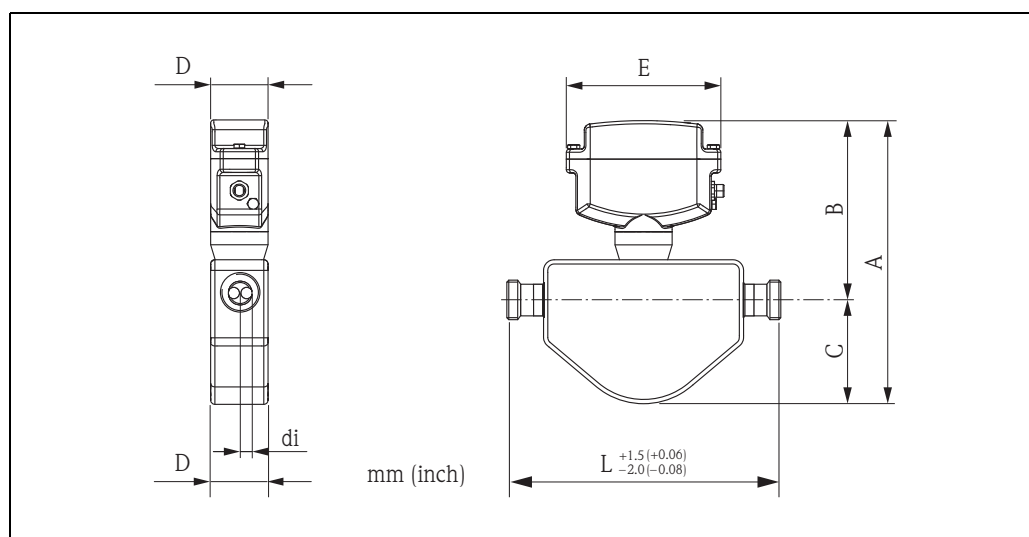

Dosimass dimensions

### Dimensions (SI units)

DN	A	B	C	D	E	L	di
8	253	160	93	54	146	*	5.35
15	267	162	105	54	146	*	8.30
25	273	167	106	54	146	*	12.00

\* dependent on respective flange connection  
All dimensions in [mm]


### Dimensions (US units)

DN	A	B	C	D	E	L	di
3/8"	9.96	6.30	3.66	2.13	5.75	*	0.21
1/2"	10.5	6.38	4.13	2.13	5.75	*	0.33
1"	10.8	6.57	4.17	2.13	5.75	*	0.47

\* dependent on respective flange connection  
All dimensions in [inch]



# Dosimass dimensions: Tri-Clamp connections

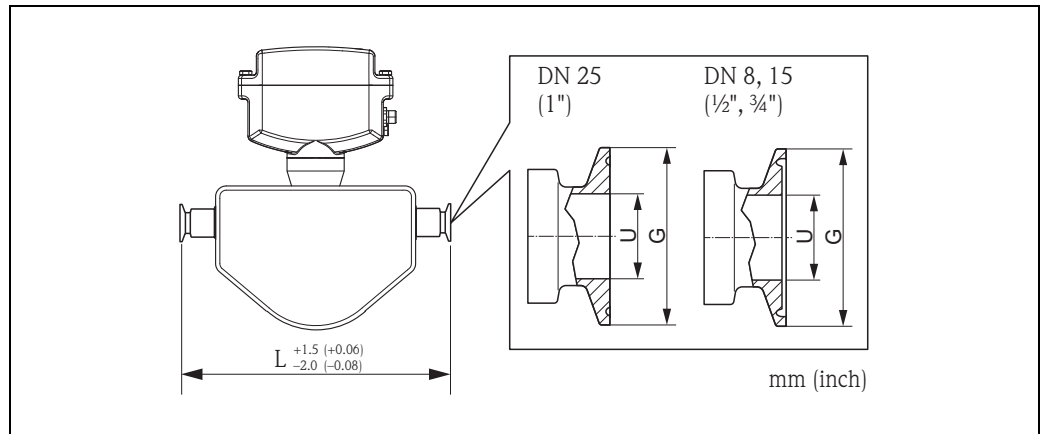

A0008579

Dosimass dimensions: Tri-Clamp connections

## Dimensions (SI units)

1/2"-Tri-Clamp: 1.4404/316L				
DN	Clamp	G	L	U
8	1/2"	25.0	229	9.5
15	1/2"	25.0	273	9.5

3A-version also available ( $R_a \leq 0.8 \mu\text{m}/150$  grit or  $R_a \leq 0.4 \mu\text{m}/240$  grit)

All dimensions in [mm]; other dimensions → 16

3/4"-Tri-Clamp: 1.4404/316L				
DN	Clamp	G	L	U
8	3/4"	25.0	229	16
15	3/4"	25.0	273	16

3A-version also available ( $R_a \leq 0.8 \mu\text{m}/150$  grit)

All dimensions in [mm]; other dimensions → 16

1"-Tri-Clamp: 1.4404/316L				
DN	Clamp	G	L	U
8	1"	50.4	229	22.1
15	1"	50.4	273	22.1
25	1"	50.4	324	22.1


3A-version also available ( $R_a \leq 0.8 \mu\text{m}/150$  grit or  $R_a \leq 0.4 \mu\text{m}/240$  grit)

All dimensions in [mm]; other dimensions → 16

*Dimensions (US units)*


½"-Tri-Clamp: 1.4404/316L				
DN	Clamp	G	L	U
3/8"	½"	0.98	9.02	0.37
½"	½"	0.98	10.8	0.37

3A-version also available ( $R_a \leq 0.8 \mu\text{m}/150$  grit or  $R_a \leq 0.4 \mu\text{m}/240$  grit)

All dimensions in [inch]; other dimensions →  16


¾"-Tri-Clamp: 1.4404/316L				
DN	Clamp	G	L	U
3/8"	¾"	0.98	9.02	0.63
½"	¾"	0.98	10.8	0.63

3A-version also available ( $R_a \leq 0.8 \mu\text{m}/150$  grit)


All dimensions in [inch]; other dimensions →  16

1"-Tri-Clamp: 1.4404/316L				
DN	Clamp	G	L	U
3/8"	1"	1.98	9.02	0.87
½"	1"	1.98	10.8	0.87
1"	1"	1.98	12.8	0.87

3A-version also available ( $R_a \leq 0.8 \mu\text{m}/150$  grit or  $R_a \leq 0.4 \mu\text{m}/240$  grit)

All dimensions in [inch]; other dimensions →  16

Dosimass dimensions: Flange connections EN (DIN)

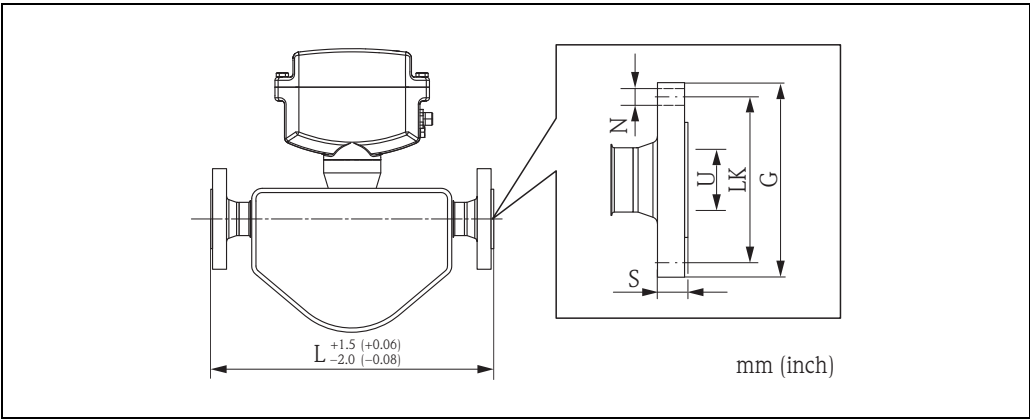

A0008785

Dosimass dimensions: Flange connections

Dimensions (SI units)

Flansch EN 1092-1 (DIN 2512N <sup>1)</sup> / PN 40): 1.4404/316L/316						
DN	G	L	N	S	LK	U
8	95	232	4 × ø 14	16	65	17.3
15	95	279	4 × ø 14	16	65	17.3
25	115	329	4 × ø 14	18	85	28.5


<sup>1)</sup> Flange with groove to EN 1092-1 Form D (DIN 2512N) available  
All dimensions in [mm]; other dimensions → 16

Dimensions (US units)

Flansch EN 1092-1 (DIN 2512N <sup>1)</sup> / PN 40): 1.4404/316L/316						
DN	G	L	N	S	LK	U
3/8"	3.74	9.13	4 × ø 0.55	0.63	2.56	0.68
1/2"	3.74	11.0	4 × ø 0.55	0.63	2.56	0.68
1"	4.53	13.0	4 × ø 0.55	0.71	3.35	1.12

<sup>1)</sup> Flange with groove to EN 1092-1 Form D (DIN 2512N) available  
All dimensions in [inch]; other dimensions → 16

Dosimass dimensions: DIN 32676 (clamp)

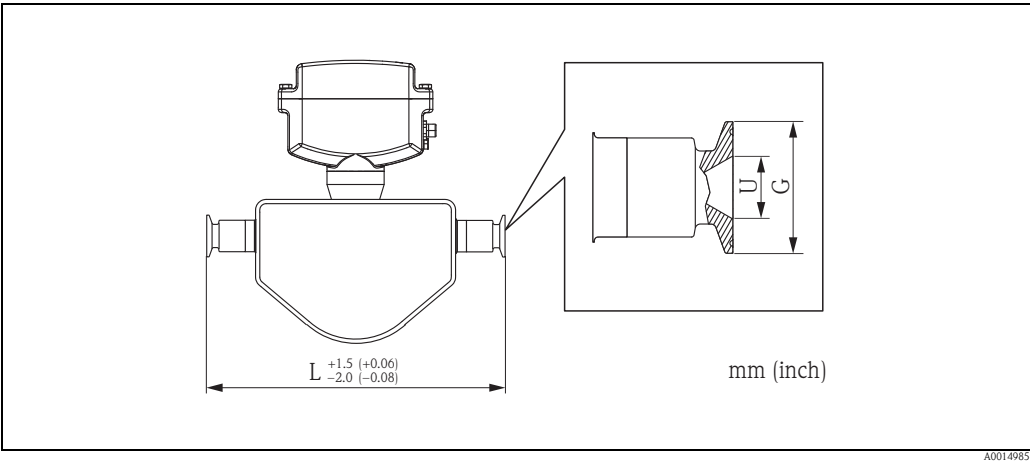

Dosimass dimensions: DIN 32676 (clamp)

Dimensions (SI units)

1" Clamp DIN 32676: 1.4435/316L			
DN	G	L	U
8	34.0	229	16
15	34.0	273	16
25	50.5	324	26


3A-version also available ( $Ra \leq 0.4 \mu\text{m}/240$  grit)  
All dimensions in [mm]; other dimensions → 16

Dimensions (US units)

1" Clamp DIN 32676: 1.4435/316L			
DN	G	L	U
3/8"	1.34	9.02	0.63
1/2"	1.34	10.8	0.63
1"	1.99	12.8	1.02

3A-version also available ( $Ra \leq 0.4 \mu\text{m}/240$  grit)  
All dimensions in [inch]; other dimensions → 16

Dosimass dimensions: DIN 11851 connections (sanitary connection)

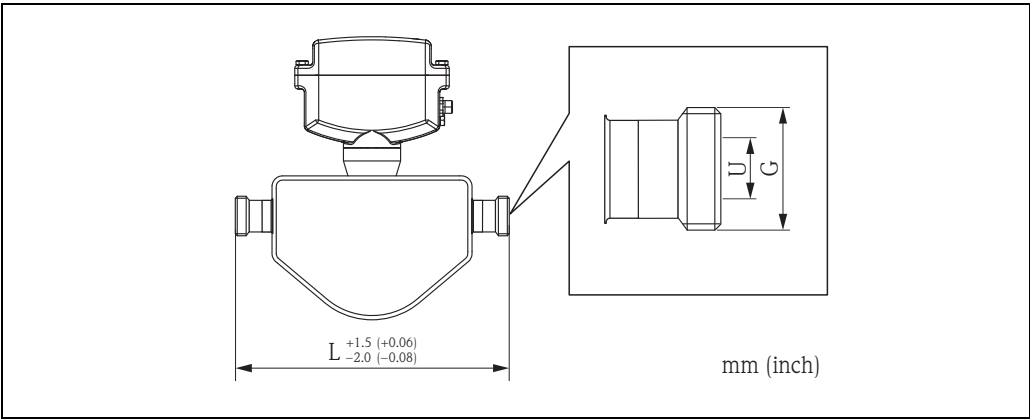

A0008578

Dosimass dimensions : DIN 11851 connections (sanitary connection)

Dimensions (SI units)

Sanitary connection DIN 11851: 1.4404/316L			
DN	G	L	U
8	Rd 34 × 1/8"	229	16
15	Rd 34 × 1/8"	273	16
25	Rd 52 × 1/6"	324	26


3A-version also available ( $Ra \leq 0.8 \mu\text{m}/150$  grit)  
All dimensions in [mm]; other dimensions → 16

Dimensions (US units)

Sanitary connection DIN 11851: 1.4404/316L			
DN	G	L	U
3/8"	Rd 34 × 1/8"	9.02	0.63
1/2"	Rd 34 × 1/8"	10.8	0.63
1"	Rd 52 × 1/6"	12.8	1.02

3A-version also available ( $Ra \leq 0.8 \mu\text{m}/150$  grit)  
All dimensions in [inch]; other dimensions → 16

Dosimass dimensions: DIN 11864-1 Form A (threaded joint)

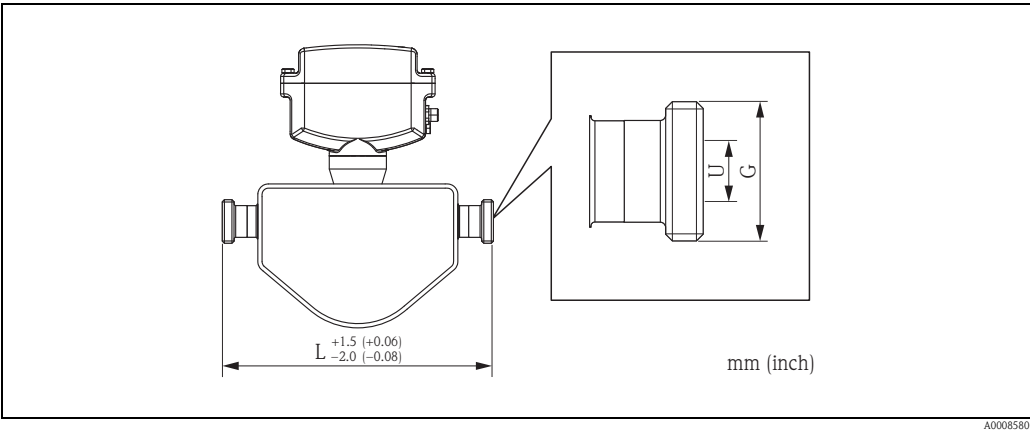

Dosimass dimensions: DIN 11864-1 Form A (threaded joint)

Dimensions (SI units)

Threaded joint DIN 11864-1 Form A: 1.4404/316L			
DN	G	L	U
8	Rd 28 × 1/8"	229	10
15	Rd 34 × 1/8"	273	16
25	Rd 52 × 1/6"	324	26


3A-version also available ( $Ra \leq 0.8 \mu\text{m}/150 \text{ grit}$ )  
All dimensions in [mm]; other dimensions → 16

Dimensions (US units)

Threaded joint DIN 11864-1 Form A: 1.4404/316L			
DN	G	L	U
3/8"	Rd 28 × 1/8"	9.02	0.39
1/2"	Rd 34 × 1/8"	10.8	0.63
1"	Rd 52 × 1/6"	12.8	1.02

3A-version also available ( $Ra \leq 0.8 \mu\text{m}/150 \text{ grit}$ )  
All dimensions in [inch]; other dimensions → 16

Dosimass dimensions : ISO 2853 connections (threaded connection)

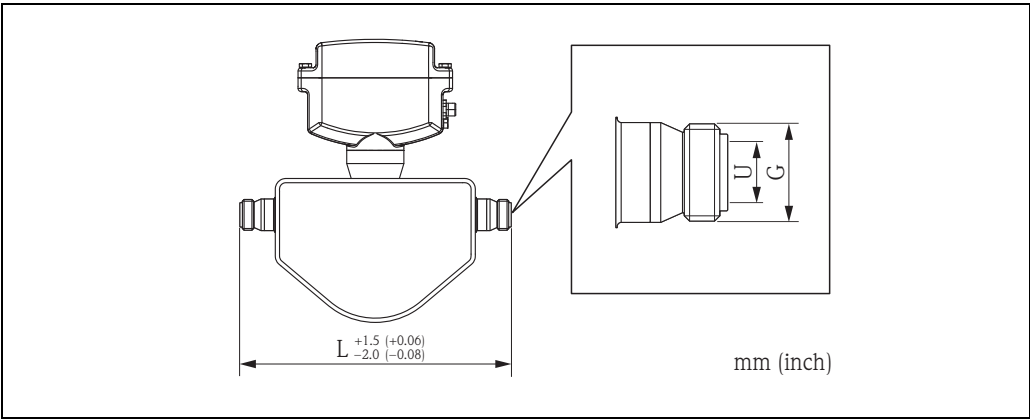

A0008581

Dosimass dimensions: ISO 2853 connections (threaded joint)

Dimensions (SI units)

Threaded joint ISO 2853: 1.4404/316L			
DN	G <sup>1)</sup>	L	U
8	37.13	229	22.6
15	37.13	273	22.6
25	37.13	324	22.6


<sup>1)</sup> Max. thread diameter to ISO 2853 Annex A  
3A-version also available (Ra ≤ 0.8 µm/150 grit)  
All dimensions in [mm]; other dimensions → 16

Dimensions (US units)

Threaded joint ISO 2853: 1.4404/316L			
DN	G <sup>1)</sup>	L	U
3/8"	1.46	9.02	0.89
1/2"	1.46	10.8	0.89
1"	1.46	12.8	0.89

<sup>1)</sup> Max. thread diameter to ISO 2853 Annex A  
3A-version also available (Ra ≤ 0.8 µm/150 grit)  
All dimensions in [inch]; other dimensions → 16

Dosimass dimensions: SMS 1145 connections (sanitary connection)

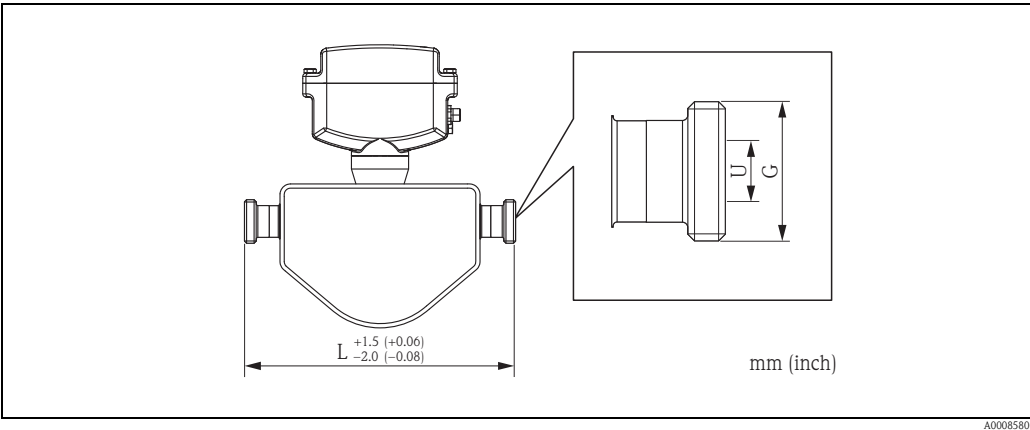

Dosimass dimensions : SMS 1145 connections (sanitary connection)

Dimensions (SI units)

Sanitary connection SMS 1145: 1.4404/316L			
DN	G	L	U
8	Rd 40 × 1/6"	229	22.5
15	Rd 40 × 1/6"	273	22.5
25	Rd 40 × 1/6"	324	22.5

3A-version also available ( $Ra \leq 0.8 \mu\text{m}/150 \text{ grit}$ )  
All dimensions in [mm]; other dimensions → 16

Dimensions (US units)

Sanitary connection SMS 1145: 1.4404/316L			
DN	G	L	U
3/8"	Rd 40 × 1/6"	9.02	0.89
1/2"	Rd 40 × 1/6"	10.8	0.89
1"	Rd 40 × 1/6"	12.8	0.89

3A-version also available ( $Ra \leq 0.8 \mu\text{m}/150 \text{ grit}$ )  
All dimensions in [inch]; other dimensions → 16

Weight

DN in mm (inch)	8 (3/8")	15 (1/2")	25 (1")
Weight in kg (lbs)	3.5 (7.7)	4.0 (8.8)	4.5 (9.9)




## Material

- Transmitter housing: 1.4308/304
- Sensor housing: Acid and alkali-resistant outer surface; stainless steel 1.4301/304
- Housing seal: EPDM
- Process connection:
  - Tri-Clamp → stainless steel 1.4404/316L
  - Flange connections EN (DIN) → stainless steel 1.4404/316L/316
  - DIN 32676 (clamp) → stainless steel 1.4435/316L
  - Sanitary connection DIN 11851 → stainless steel 1.4404/316L
  - Threaded joint DIN 11864-1 → stainless steel 1.4404/316L
  - Threaded joint ISO 2853 → stainless steel 1.4404/316L
  - Sanitary connection SMS 1145 → stainless steel 1.4404/316L
- Measuring tubes: Stainless steel 1.4539/904L
- Seals: Welded process connections without internal seals

## Material load diagram

### Flange connection EN 1092-1

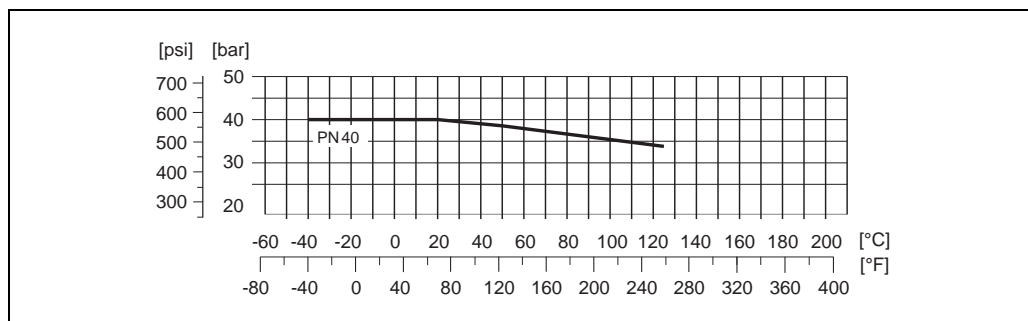


A0008822

### Connection DIN 32676 (Clamp)

PS = 16 bar (232 psi)

The clamp connections are suitable up to a maximum pressure of 16 bar (232 psi). Please observe the operating limits of the clamp and seal used as they could be under 16 bar (232 psi). The clamp and seal do not form part of the scope of supply.

### Sanitary connection as per DIN 11851 / SMS 1145

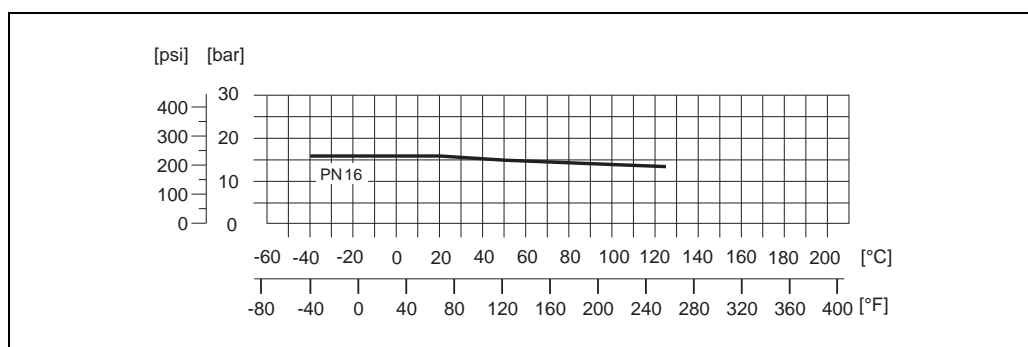


A0008607


### Tri-Clamp process connection

The load limit is defined exclusively by the material properties of the outer clamp used. This clamp is not included in the scope of delivery.

Threaded joint DIN 11864-1

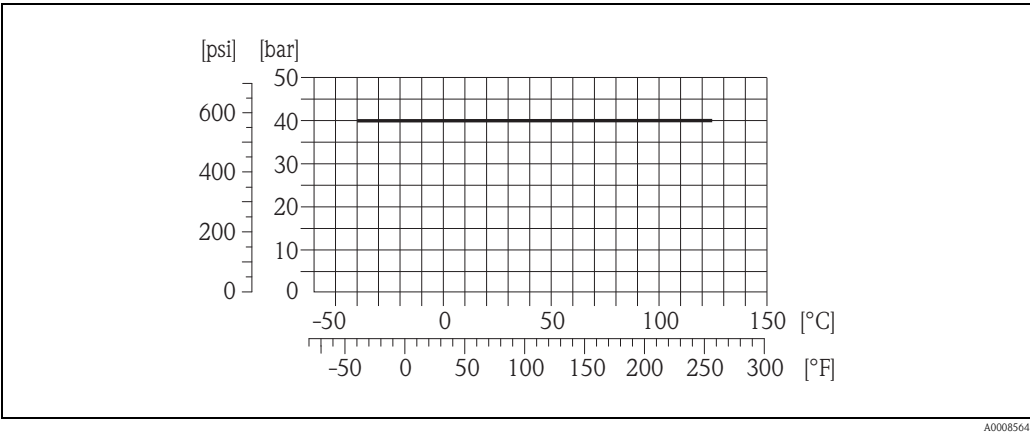

Threaded joint ISO 2853

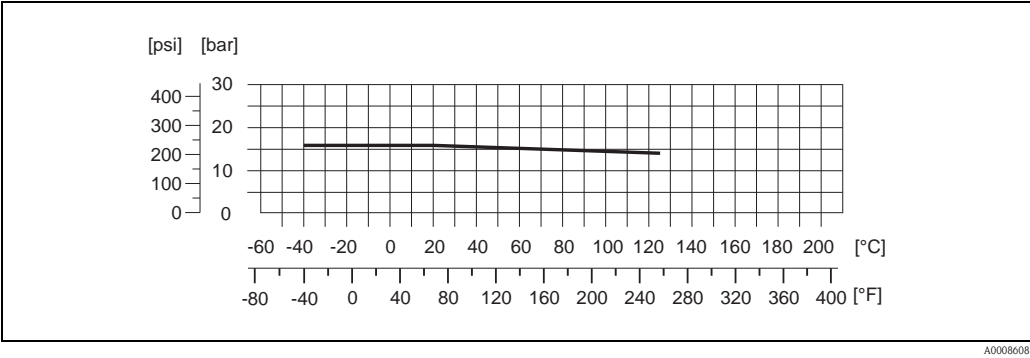

Process connection	Sanitary connections: <ul style="list-style-type: none"><li>■ Tri-Clamp</li><li>■ threaded joints (DIN 11851, SMS 1145, ISO 2853, DIN 11864-1)</li></ul>
--------------------	--

Operability

Display elements	Dosimass does not have a display or display elements.
Remote operation	Operation takes place via the "FieldCare" configuration and service program from Endress+Hauser. This can be used to configure functions and read off measured values.

Certificates and approvals

CE mark	The measuring system is in conformity with the statutory requirements of the EC Directives. Endress+Hauser confirms successful testing of the device by affixing to it the CE mark.
C-tick mark	The measuring system meets the EMC requirements of the "Australian Communications and Media Authority (ACMA)".
Ex approval	Information about currently available Ex versions (ATEX, FM, CSA, etc.) can be supplied by your Endress+Hauser Sales Centre on request. All explosion protection data are given in a separate documentation which is available upon request.

**Sanitary compatibility**

3A-authorized

**Pressure measuring device approval**

The measuring devices can be ordered with or without PED (Pressure Equipment Directive). If a device with PED is required, this must be ordered explicitly. For devices with nominal diameters less than or equal to DN 25 (1"), this is neither possible nor necessary.

- With the identification PED/G1/III on the sensor nameplate, Endress+Hauser confirms conformity with the "Basic safety requirements" of Appendix I of the Pressure Equipment Directive 97/23/EC.
- Devices with this identification (with PED) are suitable for the following types of fluid:
  - Fluids of Group 1 and 2 with a steam pressure greater than, or smaller and equal to 0.5 bar (7.3 psi)
  - Unstable gases
- Devices without this identification (without PED) are designed and manufactured according to good engineering practice. They correspond to the requirements of Art. 3, Section 3 of the Pressure Equipment Directive 97/23/EC. Their application is illustrated in Diagrams 6 to 9 in Appendix II of the Pressure Equipment Directive 97/23/EC.

**Other standards and guidelines**

- EN 60529  
Degrees of protection by housing (IP code)
- EN 61010-1  
Protection Measures for Electrical Equipment for Measurement, Control, Regulation and Laboratory Procedures
- IEC/EN 61326  
"Emission in accordance with Class A requirements"  
Electromagnetic compatibility (EMC requirements)
- EN 61000-4-3 (IEC 1000-4-3)  
Operating behaviour A with screened connecting cable possible (screening placed as short as possible on both sides), otherwise operating behaviour B
- NAMUR NE 21  
Electromagnetic compatibility (EMC) of industrial process and laboratory control equipment

## Ordering information

Detailed order information is available from following sources:

- In the Product Configurator on the Endress+Hauser website: [www.endress.com](http://www.endress.com) → Select country → Instruments → Select device → Product page function: Configure this product
- From your Endress+Hauser Sales Center: [www.endress.com/worldwide](http://www.endress.com/worldwide)

Information: Product Configurator – the tool for individual product configuration

- Up-to-the-minute configuration data
- Depending on the device: Direct input of measuring point-specific information such as measuring range or operating language
- Automatic verification of exclusion criteria
- Automatic creation of the order code and its breakdown in PDF or Excel output format
- Ability to order directly in the Endress+Hauser Online Shop

## Accessories

Various accessories and spare parts, which can be ordered separately from Endress+Hauser, are available for the transmitter and sensor. Detailed information on the order code in question can be obtained from your Endress+Hauser service organization.

Accessories	Description	Ordering code
Applicator	Software for selecting and configuring flowmeters. Applicator can be downloaded from the Internet or ordered on CD-ROM for installation on a local PC. Contact your Endress+Hauser representative for more information.	DKA80 - *

Accessories	Description	Ordering code
FieldCare	Configuration and service software for flowmeters in the field: – Commissioning, maintenance analysis – Configuring measuring devices – Service functions – Visualization of process data – Troubleshooting  Contact your Endress+Hauser representative for more information.	DXS10 – * * * * *
Housing seal	EPDM seal to seal the cover	50104802
FXA193	Service interface connecting cable from the device to the PC for operation via FieldCare	FXA193 – *
Service adapter	Adapter for connecting FXA193 to the device.	50106443
Electronics module	For operating the device	50106416
Fuse set	10 device fuses (T2A00/125)	50106219
Adapter RSE8	Lumberg RSE8 female, adapter 8pole (RSE8), 24 V DC, pulse, status	50107169
Adapter RSE5	Lumberg RSE8 female, adapter 5pole (RSE5), 24 V DC, pulse, status	50107168
Adapter RSE4	Lumberg RSE8 female, adapter 4pole (RSE4), 24 V DC, pulse	50107167
Feed cable RSE8	Lumberg cable RKWTN8-56/5 P92	50107895

## Documentation

- Dosimass Operating Instructions (BA00097D/06/EN)
- Supplementary documentation on Ex-ratings: ATEX

## Registered trademarks

TRI-CLAMP®

Registered trademark of Ladish & Co., Inc., Kenosha, USA

FieldCare®, Fieldcheck®, Applicator®, HistoROM™

Registered or registration-pending trademarks of Endress+Hauser Flowtec AG, Reinach, CH

### Instruments International

Endress+Hauser  
Instruments International AG  
Kaegenstrasse 2  
4153 Reinach  
Switzerland

Tel.+41 61 715 81 00  
Fax+41 61 715 25 00  
www.endress.com  
info@ii.endress.com

**Endress+Hauser**   
People for Process Automation