

AOBOET

Our Environment, Our Energy, Our Future



User Manual

Uhome-LFP 5000 Lithium Battery Storage

About AOBOET Uhome-LFP 5000 battery

Uhome-LFP 5000 battery can be installed in Parallel and Series mode, more attention should be paid for the DIP and address selection following with part 5.3.2.

About this manual

This manual is intended for the AOBOET Uhome-LFP 5000 Energy Storage battery, but the hybrid inverter and any other equipment is not included. The AOBOET hot line and <http://ess.aoboet.com.au> are both available if you want to get additional information.

Declaration

AOBO declares that this Uhome-LFP 5000 is compliance with the essential requirements and other relevant of RE Directive 2014/53/EU. The declaration of conformity may be consulted at <http://ess.aoboet.com.au>.

Contents

About AOBOET Uhome-LFP 5000 battery	
About this manual	
Declaration	
1. Safety introduction	1 -
1.1 Important Safety Instructions	1 -
1.2 Warnings in this Document	1 -
1.3 Battery handing guide.....	1 -
1.4 Response to emergency situations	2 -
1.5 Installers	3 -
1.6 APP download.....	3 -
1.7 Scrap battery.....	3 -
1.8 Contact information.....	3 -
2. Product Introduction	4 -
2.1 Technical data	4 -
2.2 Exploded views of battery.....	4 -
2.3 Indicator and ports	6 -
2.4 Communication interface plat (DVC-A ₂ voltage)	6 -
2.5 How it works	6 -
2.6 Feature	7 -
3. Guidance for disconnection of batteries during shipment	8 -
4. Installation Prerequisites	9 -
4.1 Installation location	9 -
4.2 Installation process	9 -
4.3 Installation materials	10 -
4.4 Tools	10 -
4.5 Safety instruments	10 -
4.6 Network cable	10 -
4.7 Storage.....	11 -

5.	Battery Installation	- 12 -
5.1	Package items	- 12 -
5.2	Checks before installation	- 12 -
5.3	Installation the battery	- 12 -
5.3.1	Install the battery	- 12 -
5.3.2	Address select of Primary and Sub battery(ies) connection	- 14 -
5.4	Cable connections	- 17 -
5.4.1	Cable connection for Series connection	- 17 -
5.4.2	Cable connection for Parallel connection	- 18 -
6.	Configuration	- 21 -
6.1	Configure device WIFI	- 21 -
6.2	Register your account	- 22 -
6.3	Settings for CAN /485 bus pins	- 24 -
7.	Commissioning	- 25 -
7.1	Commissioning battery	- 25 -
7.2	Shut down battery	- 25 -
8.	Firmware Update	- 26 -

1. Safety introduction

1.1 Important Safety Instructions

This manual contains important instructions for:

Uhome-LFP 5000 Energy Storage product

and this manual must be followed when installing and using this product.

The product is designed and tested in accordance with international safety requirements IEC 60364, but as with all electrical and electronic equipment, certain precautions must be observed when installing and/or operating the product. To reduce the risk of personal injury and ensure the safe installation and operation of the product, you must carefully read and follow all instructions, cautions and warnings in this manual.

1.2 Warnings in this Document

A warning describes a hazard to equipment or personnel. It calls attention to a procedure or practice, which, if not correctly performed or adhered to, could result in damage to or destruction of part or all of the ABOET equipment and/or other equipment connected to the ABOET equipment or personal injury.

Symbol	Description
	Caution, risk of electric shock
	Heavy enough may cause severe injury
	Keep the battery away from open flame or ignition sources
	Keep the battery away from children
	Do not dispose of the product with household waste
	Recycling
	Read this manual before installation and operation

For safety reasons, installers are responsible for familiarizing themselves with the contents of this manual and all warnings before performing installation.

1.3 Battery handling guide

- Use the battery pack only as directed.
- If the battery defective, appears cracked, broken or otherwise damaged, or fails to operate, contact the ABOET hot line immediately.
- Do not attempt to open, disassemble, repair, tamper with, or modify the battery. The battery pack is not user serviceable.
- To protect the battery and its components from damage when transporting, handle with care.
- Do not subject it to any strong force.

- Do not insert foreign objects into any part of the battery pack.
- Do not use cleaning solvents to clean the battery.
- The battery shall not be connected directly to SELV circuit.

1.4 Response to emergency situations

The AOBOET Uhome battery is designed with multiple safety strategies to prevent hazards resulting from failures. However, AOBOET cannot guarantee their absolute safety for uncertain situations.

1.4.1 Leaking batteries

If the battery pack leaks electrolyte, avoid contact with the leaking liquid or gas. Electrolyte is corrosive and contact may cause skin irritation and chemical burns. If one is exposed to the leaked substance, do these actions:

Inhalation: Evacuate the contaminated area, and seek medical attention immediately.

Eyes contact: Rinse eyes with flowing water for 15 minutes, and seek medical attention immediately.

Skin contact: Wash the affected area thoroughly with soap and water, and seek medical attention immediately.

Ingestion: Induce vomiting as soon as possible, and seek medical attention immediately.

1.4.2 Fire

In case of a fire, make sure that an ABC or carbon dioxide extinguisher is nearby and does not use water to extinguish the fire.



WARNING

The battery pack may catch fire when heated above 130°C.

If a fire breaks out where the battery is installed, do these actions:

1. Extinguish the fire before the battery catches fire.
2. If the battery has caught fire, do not try to extinguish the fire.

Evacuate people immediately.

WARNING

If the battery catches fire, it will produce poisonous gases. Do not approach.

1.4.3 Wet battery

If the battery is wet or submerged in water, do not try to access it. Contact AOBOET hot line or your distributor for technical assistance.

1.4.4 Damaged battery

If the battery damaged, please contact AOBOET hot line or your distributor for help as soon as possible, because damaged battery is dangerous and must be handled with extreme caution. Damaged battery is not suit for use and may pose a danger to people or property. If the battery seems to be damaged, return it to AOBOET or your distributor.

CAUTION

Damaged battery might export electrolyte or flammable gas, so contact AOBOET for advice and information immediately we will deal with it within 48h.

1.5 Installers

AOBOET Energy Storage battery is suggested installing by skilled worker or electrician. A skilled worker is defined as a people who had been trained and qualified electrician or had all of the following skills and experience:

- Knowledge of the functional principles and operation of on-grid Energy Storage systems.
- Knowledge of the dangers and risks associated with installing and using electrical devices and acceptable mitigation methods.
- Knowledge of the installation of electrical devices
- Knowledge of and adherence to this manual and all safety precautions and best practices.

1.6 APP download

Aobo Energy storage battery monitor that can scan this QR code with your browser and download the APP



1.7 Scrap battery

For scrap battery(-ies), please treat with local laws or regulations to recycle or scrap.

1.8 Contact information

Use the contacts below for technical assistance. This phone numbers is available only during business hours on weekdays.

Phone number 86-510-85366880

Address Sumiao Village, Qianqiao Street, Huishan District, Wuxi City
(Industrial Concentration Zone)

E-mail info@aoboet.com.au

2. Product Introduction


2.1 Technical data

Model		Uhome-LFP 5000
Total Energy*		5.1kWh
Usable Energy(DC)*		4.8kWh
Nominal Charge/Discharge Power		3.0kW
Peak Power(Only discharge)		6.0kW for 3 seconds
Constant Current(Only discharge)		80A
Voltage		48~56Vd.c
Nominal Voltage		51.2Vd.c
Nominal Current		60A
Max. Charge Voltage		57.6V
Max. Recommended DOD (Off-grid)		90%
Operating Condition		Indoor
Operating Temperature	Charge	From 0~50℃
	Discharge	From -10~55℃
Dimension(L*W*H)		500*442*135 mm
WIFI Frequency Range		2400MHz-2483MHz
Max. Transmission Power		<20dBm
Weight		45kg
Humidity		< 60% (No Condensed Water)
Pollution Degree		3
Over Voltage Category		II
Cooling Type		Natural cooling
Case Material		Metal
Color		Black or Grey
Installation		Wall Mounting/ Ground Installation
IP rating		IP 20
Protective Class		I
Max. Number of Parallel or Series		8S/4P
Warranty		10 years
Communication		CAN/ RS485
Protection Mode		Dual hardware protection
Battery Protection		Over-current/Over-voltage/Short circuit/ Under-voltage/Over temperature
Safety		Cell CE+CB
		Pack TUV(IEC 62619, IEC 62040-1)
Hazardous Material Classification		9
Transportation		UN 38.3

Testing conditions based on temperature 25℃ at the beginning of life.

*Total Energy/Usable Energy measured under specific conditions from ABOET 0.2C CC-CV

2.2 Exploded views of battery

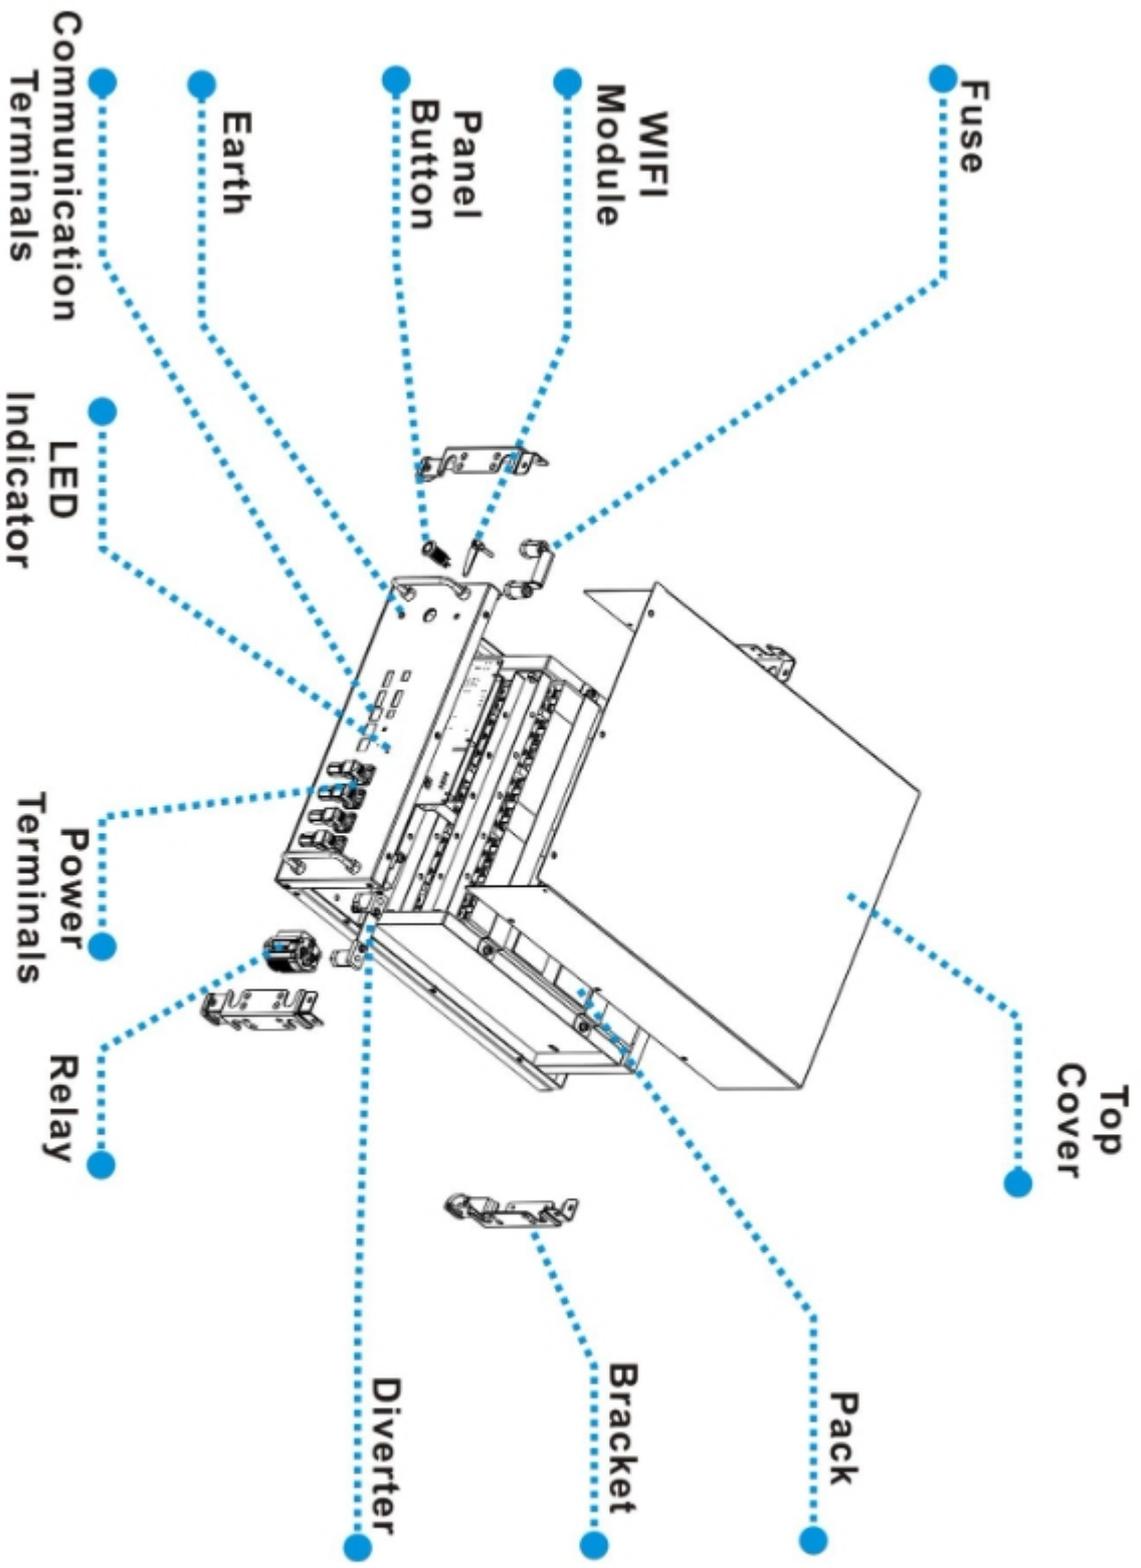

2.3 Indicator and ports

2.3.1 Indicator

There are two LED indicators on the front of the battery to show its operating status.


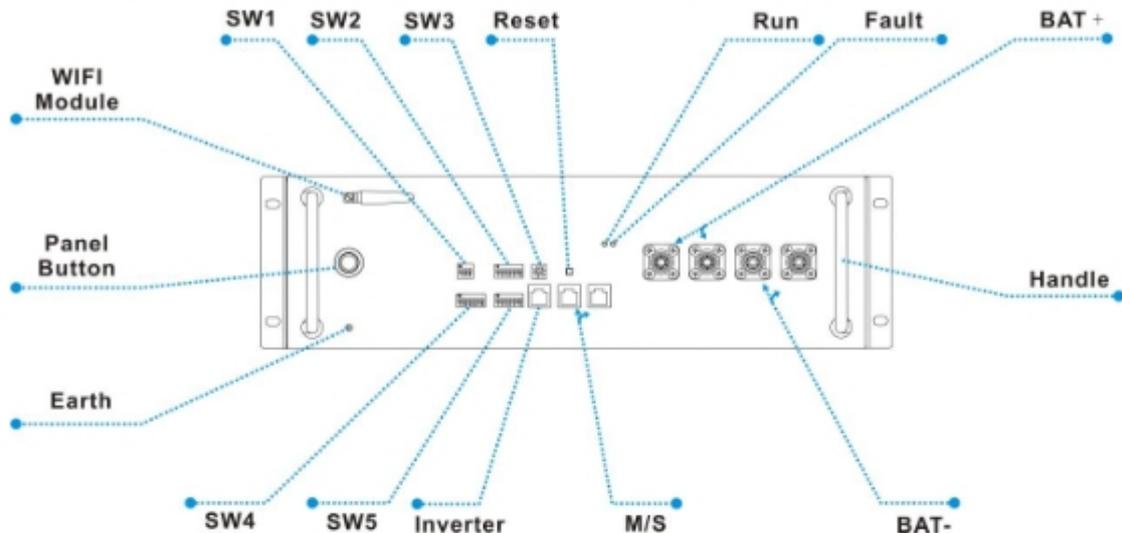


Table 2-1 Designations on the battery


Item	Designation	Definition
1	Running	Battery normally working without fault
2	Fault	Battery is in a warning state

2.4 Communication interface plat (DVC-A₂ voltage)

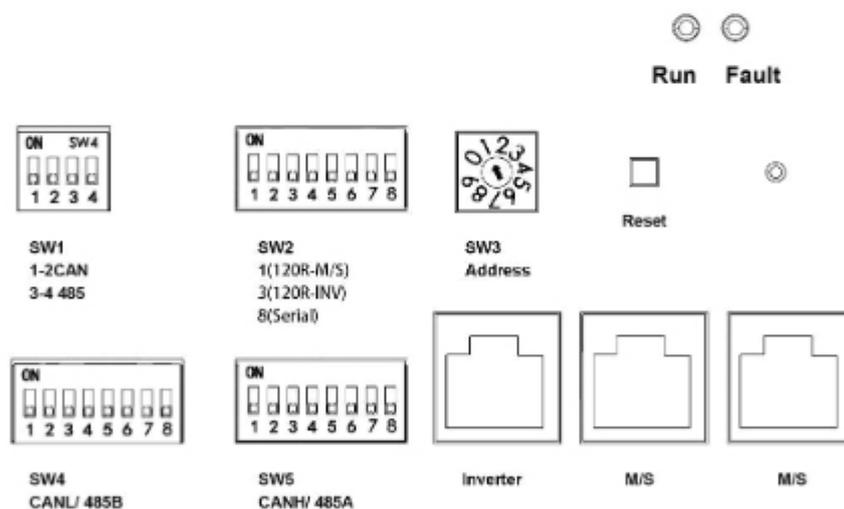

SW1	DIP switch select for CAN or RS485
SW2	Resistance for communication and DIP switch for parallel or Series connection
SW3	Switch for battery's Address select
SW4 & SW5	Communication interface for battery or Primary battery with Inverter
Reset	Reset the WIFI or GPPS/GPS module configure

2.5 How it works

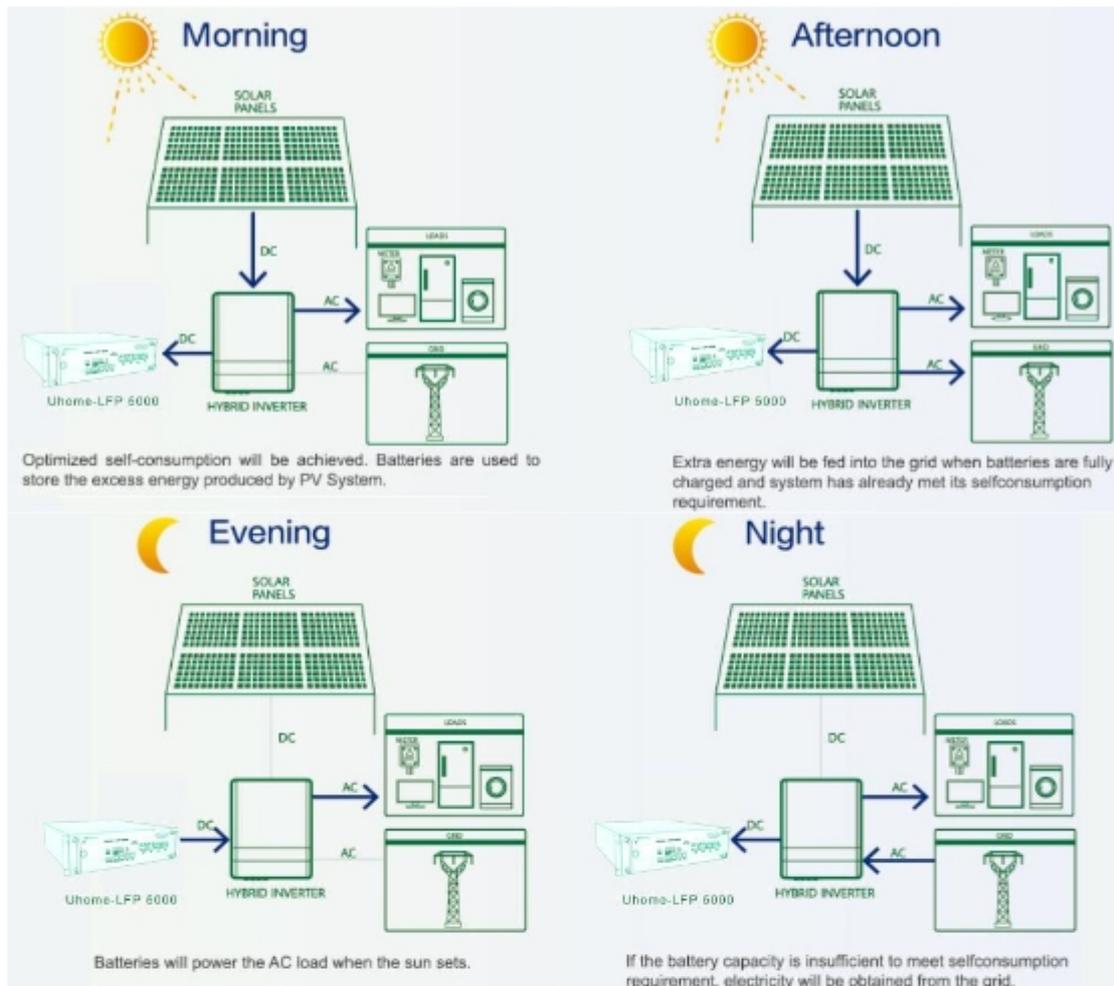


2.6 Feature

The ABOET Uhome Energy Storage battery has following features:

- **Energy storage unit:** This battery is suit for photovoltaic system compatibility.
- **Battery management system (BMS):** The battery built-in BMS monitors its operation and prevents the battery from operating outside design limitations.
- **Monitor:** The battery BMS built-in with WIFI module, the battery running information could be seeing in mobile phone and computer.
- **Easy firmware update:** The BMS firmware can be updated to the latest version. See **Chapter 8 Firmware Update**.
- **Expandability:** The battery capacity can be increased by adding another battery. See **part 5.4 Cable connection**.

3. Guidance for disconnection of batteries during shipment

- 3.1 Cartons that have been crushed, punctured, or torn in such a way that contents are revealed shall be set aside in an isolated area and inspected by a skilled person. If the package is deemed to be not shippable, the contents shall be promptly collected, segregated, and either the consignor or consignee contacted.
- 3.2 The DC circuit of AOB0ET Uhome-LFP 5000 battery has been disconnected before outgoing.
- 3.3 A precautionary label had been affixed to the shipping carton to alert individuals as to the battery within the package have been disconnected; otherwise, the battery should not be transported.
- 3.4 We have conducted comprehensive tests to ensure the equipment they distribute around the world is safe for **shipping** transport. These products shall be handled with care and immediately inspected if visibly damaged. If the cartoon visibly damaged, please contact with AOB0ET hot line to confirm whether the battery could be used safely or not.

 CAUTION IF DAMAGED	
 Battery is NOT connected	 BATTERIES, NON-SPILLABLE Packages, crushed, punctured, or torn such that contents are revealed, should be set aside in an isolated area and be inspected by a qualified person. If the package is deemed to be not shippable, contents shall be promptly collected, segregated, and either the consignor or consignee contacted.

4. Installation Prerequisites

4.1 Installation location

Make sure that the installation location meets the following conditions:


- The building is designed to withstand earthquakes.
- Far away from the sea to avoid salt water and humidity.
- The floor is flat and level.
- No flammable or explosive materials nearby.
- Optimal ambient temperature is between 15°C and 30°C.
- Temperature and humidity stays at a constant level.
- Minimal dust and dirt in the area.
- No corrosive gases present, including ammonia and acid vapor.

The ABOET Uhome battery is rated at IP20, so the battery only suite for indoor usage.

If the ambient temperature is outside the operating range, battery will protect itself by shutting down. The battery optimal operate temperature is 15°C to 30°C. Frequent exposure to severe operating condition would exacerbate the performance and lifetime of the battery.

4.2 Installation process

The battery should be installed according to the following flow chart. The detail installation process described in chapter 4 Install process.

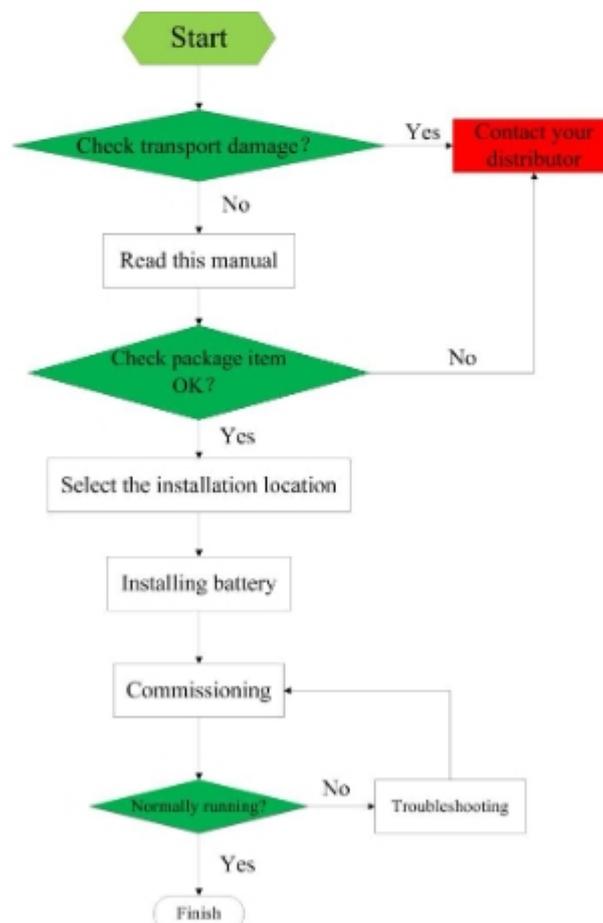

4.3 Installation materials

Following installation materials should be prepared by installers.

- Power cable
- Data cable
- Ground wire
- Bipolar external isolator, when two or more battery systems in parallel, each of them shall have a bipolar isolator.

NOTICE

Make sure that the cross-sectional area of charging cables is 25 to 35 mm².

NOTICE

A breaker between ABOET battery and inverter was recommended to install, and the breaker's min. current should be over 150A or following with local regulations.

4.4 Tools

To install the battery pack, those following tools are probably required:



Phillips screwdriver



Torque wrench



Cable crimper



Wire clamp



Voltmeter



Tape measure



Drill



Flat-head screwdriver

In order to protect operator and installer's safety, please select and use suitable tools and measuring instruments that are certified for precision and accuracy.

4.5 Safety instruments

When dealing with the battery, following safety gears should be equipped. Installers must meet the relevant requirements of IEC 60364 or the domestic legislation and other relevant international standards.



Insulated glove




Safety goggles



Safety shoes

4.6 Network cable

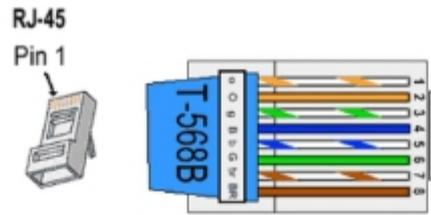

If needed, the network cable should be made like that diagram. But the network cable between battery and Inverter should be made following the definition of Inverter. If available, use a LAN cable tester to check whether the cable is faulty.

4.7 Storage

If the battery is not to be installed immediately, or removed from operation and needs to be stored for a long period, please choose an appropriate location to store it.

Instructions for storage are:

- Do not stack more than 8 battery boxes.
- The temperature of battery stored recommended in the range of -20°C to 25°C.
- Do not expose to water

The battery box should be upright as shown in the following figure and not stacked upside down when storing the battery box.



If the battery needs to be stored over 3 months, the DC circuit of battery suggests to be disconnecting. Otherwise, the battery would discharge at a minimum rate and capacity degrades depended on storage time, the battery self-consumption less than 5w. And, if the battery stored over 6 months, it is suggested to connect the battery with inverter and commission the system.

5. Battery Installation

5.1 Package items

These items are included in the package.



Battery*1



Cardboard*1



User Manual & Warranty



Ground Line



Power cable*2
(Optional)



Data Cable*1

5.2 Checks before installation

There are a few things to check before installing the battery to ensure that it has no defects.

Check item 1: Check the battery voltage.

WARNING

If this checking process is executed for any reason after the battery is fully installed, make sure that the inverter is turned off or break the connection between battery and inverter while checking the battery.



Press and hold the panel button for about 4s and then release it after the two LED lights on, measure the voltage at the terminal interface with a voltmeter. If the voltage is lower than 48 V, do not use the battery and contact AOB OET hot line or your distributor.

5.3 Installation the battery

NOTICE



The symbol located on the front of battery, and the earth wire between battery and inverter is compulsive for Series Connection. For Parallel connection, the earth wire was recommended to be installed.


5.3.1 Install the battery

To prevent the battery from moving, make sure the battery fixed to a wall.

NOTICE

If the battery is installed above the floor or on a platform, make sure that the wall or platform is capable of supporting the battery's weight.

5.3.1.1 Wall mounting

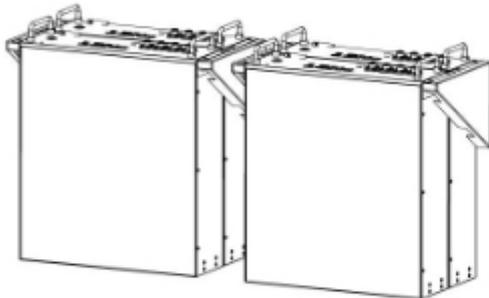


1. Determine bracket mounting place to be fixed using this Positioning cardboard.
2. Drill holes in the wall for the M8 expansion screw anchors, which depth should be at least 50 mm. Tighten the screws to a torque around 2.5 N·m.
3. Fasten the battery to bracket fasten hole with M6 screws with 2.0N·m roughly.
4. Meanwhile, two or four batteries could be installed by these brackets.


Note: if more than 4 batteries installed, a cabinet recommended to be selected for the battery's stable.

5.3.1.2 Ground installation



Meanwhile, Uhome-LFP 5000 battery also could be installed on floor, the installation step as following:

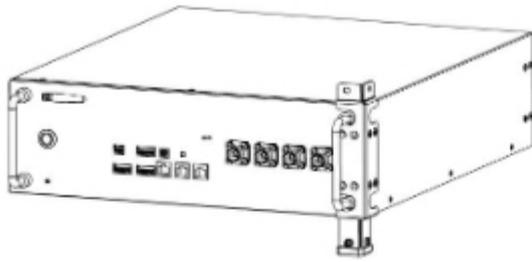


1. Fix the braced feet to battery's mounting holes one by one.

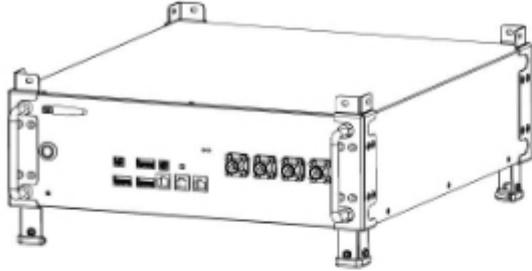

2. If more power and energy needed, two or more (less than 4) batteries could be installed in one stack.
3. But if the number of batteries at the range of 4~8, a cabinet recommended to be selected.

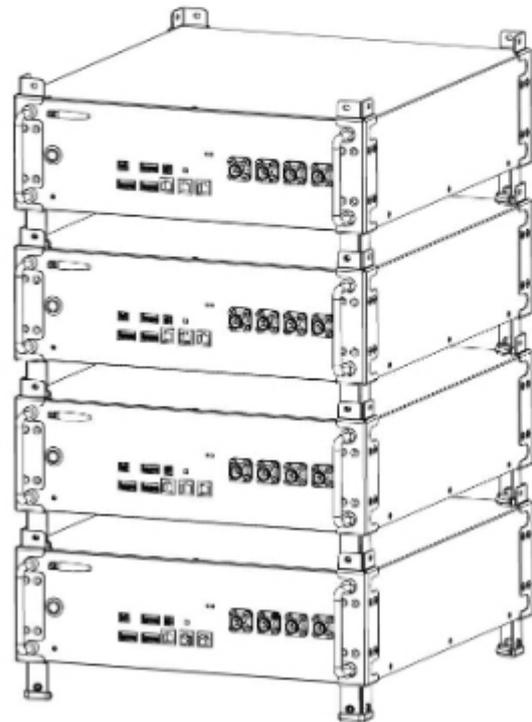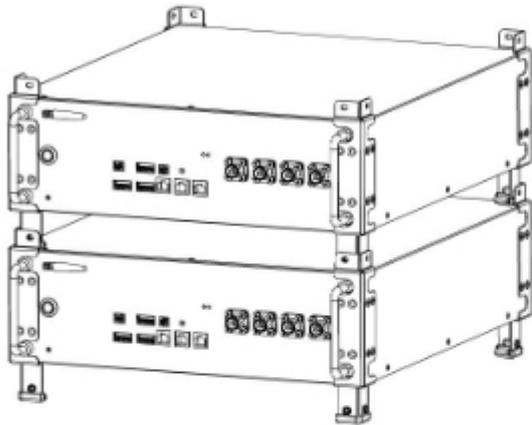

5.3.2 Address select of Primary and Sub battery(ies) connection

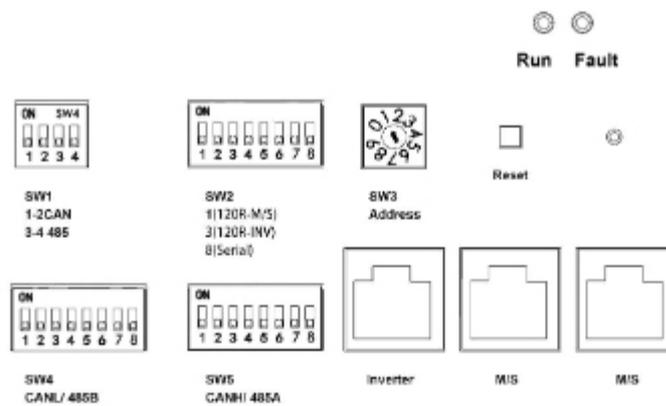

For Series connection, please make sure the SW2 DIP switch of selected as this type.

WARNING
Please make sure the SW2 DIP switch selected correctly, if the battery connected in Parallel mode, but select SW2 DIP8 at ON position, probably lead serious fault even dangerous. Meanwhile, if battery connected in Series mode select SW2 DIP8 at OFF status, serious fault and dangerous probably occurred.

Connected battery number	Group	Set of SW2		Address Set (SW3)
		Series connect	Parallel connect	
1	—			
2	Primary			
	Sub			
3	Primary			
	Sub 1			
	Sub 2			
4	Primary			
	Sub 1			
	Sub 2			
	Sub 3			
5	Primary		-	

	Sub 1		-	
	Sub 2		-	
	Sub 3		-	
	Sub 4		-	
6	Primary		-	
	Sub 1		-	
	Sub 2		-	
	Sub 3		-	
	Sub 4		-	
	Sub 5		-	
7	Primary		-	
	Sub 1		-	
	Sub 2		-	
	Sub 3		-	
	Sub 4		-	
	Sub 5		-	
	Sub 6		-	
8	Primary		-	
	Sub 1		-	
	Sub 2		-	
	Sub 3		-	
	Sub 4		-	

	Sub 5		-	
	Sub 6		-	
	Sub 7		-	

5.4 Cable connections

WARNING


Before connecting battery with inverter, please make sure that no inverter connected or the inverter turned off

5.4.1 Cable connection for Series connection


NOTICE

The voltage difference of each battery should be less than 100mV.

5.4.1.1 Ground installation

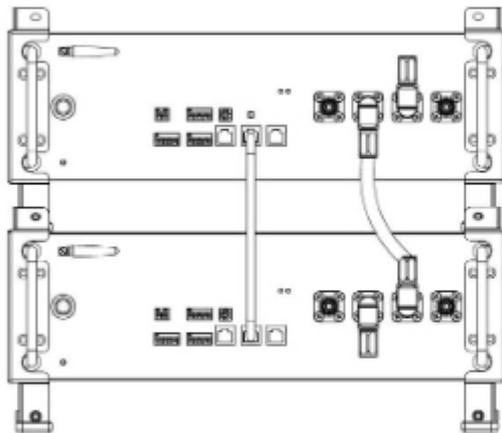


Feed a data cable to M/S communication terminal interface one by one directly.

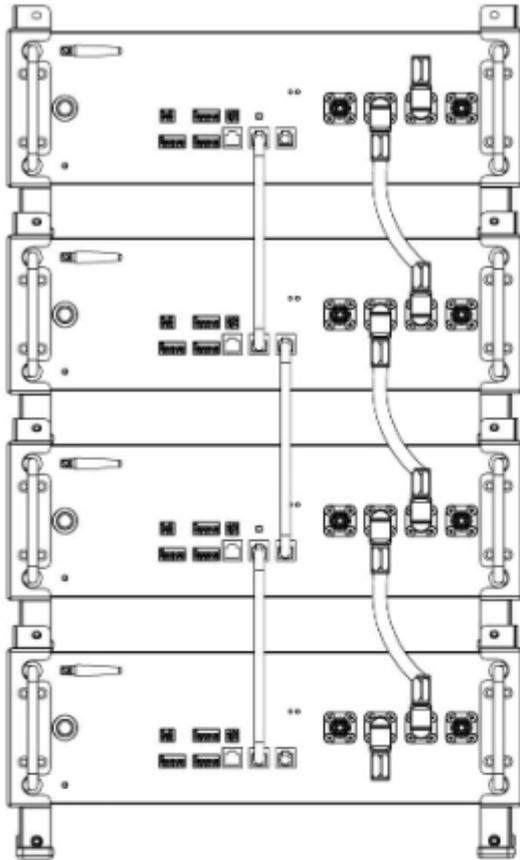


If more than 4 batteries installed, a cabinet was recommended.

5.4.1.2 Wall mounting

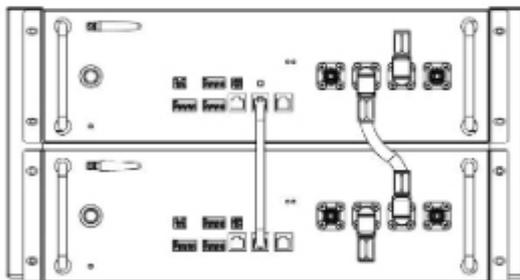


For wall mounting, the battery Series connection number should be less than 4, if more batteries installed, a cabinet was recommended.

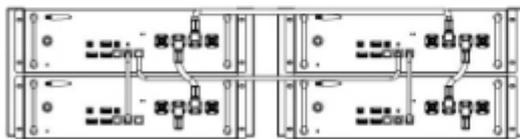


NOTICE If battery connected in Series mode, it's better to be installed in Ground installation method, for the Power cable resistance difference between stack and battery pack, which will have fade effect on voltage balance.

5.4.2 Cable connection for Parallel connection


5.4.2.1 Ground installation

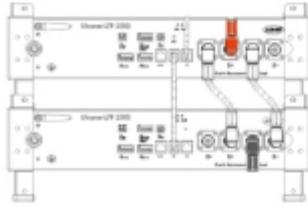


For parallel installation, please pay attention on Cable connection, and the DIP8 of SW2 no need to be changed and stayed on Initial Factory state.

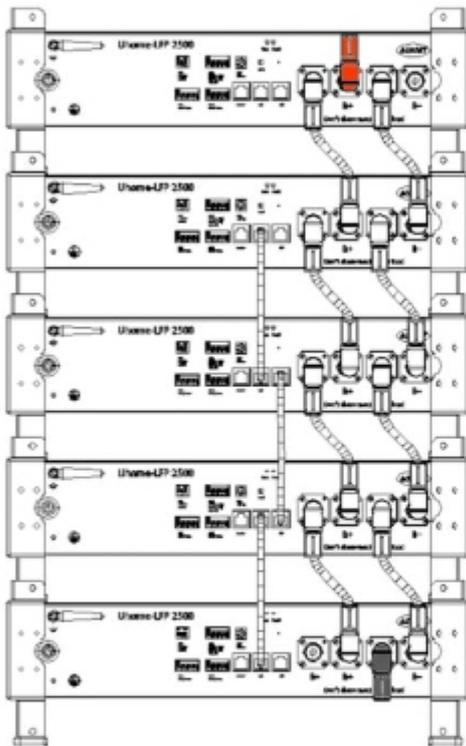

5.4.2.2 Wall mounting

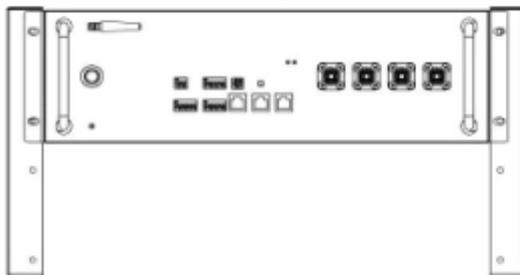

For wall mounting, the battery Series connection number should be less than 4, if more batteries installed, a cabinet was recommended.

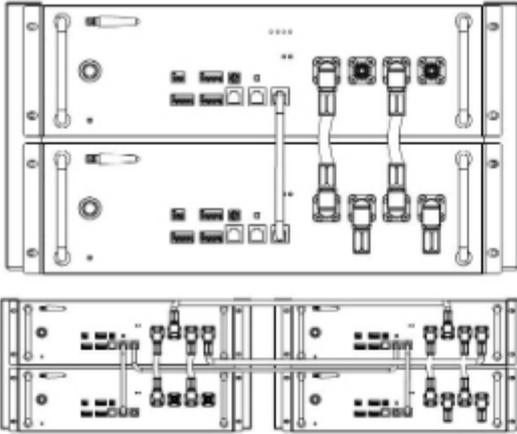

NOTICE

Before two or more batteries installed in parallel, please check the voltage of each battery and make sure the voltage different less than 1.0V.

6. Configuration

DIP switch should be set correctly for proper communication between inverter and battery.


6.1 Configure device WIFI

The ABOET Uhome battery has a built-in WIFI module for use with the **Uhome** APP.





Uhome

1. Turn on battery and Press the "Reset" button for 2 seconds, the light on the battery starts flashing and searching network.

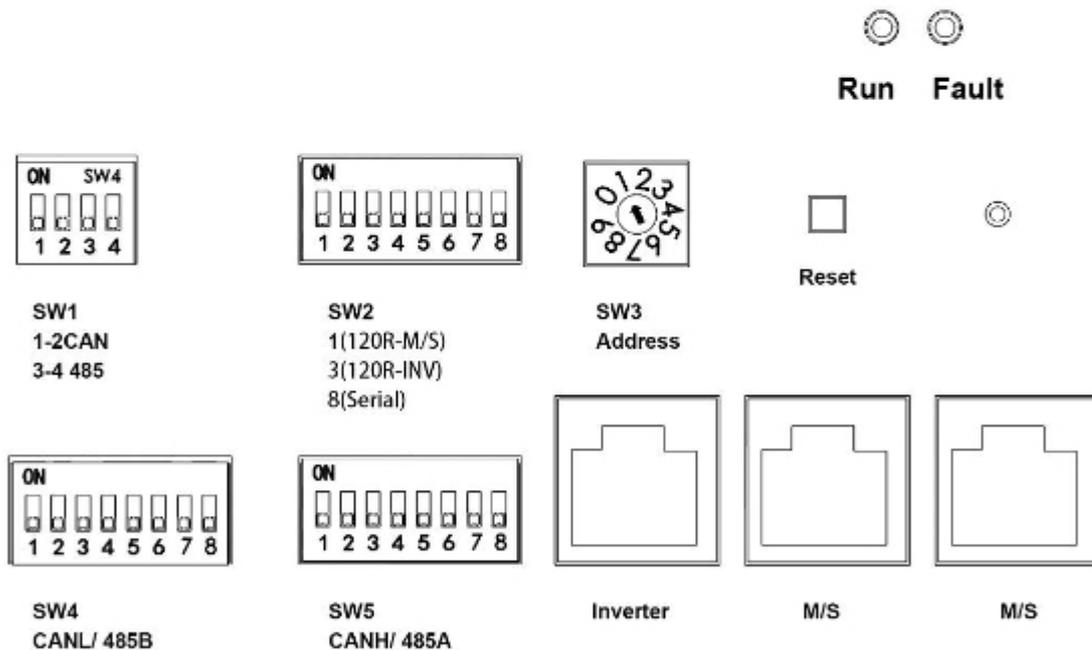

2. Open Uhome APP , select 'Config Wifi' option box, wifi config mode select 'ESP'.

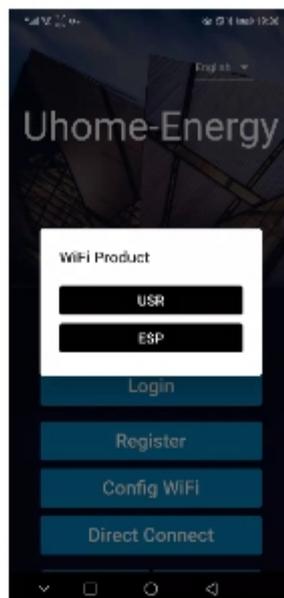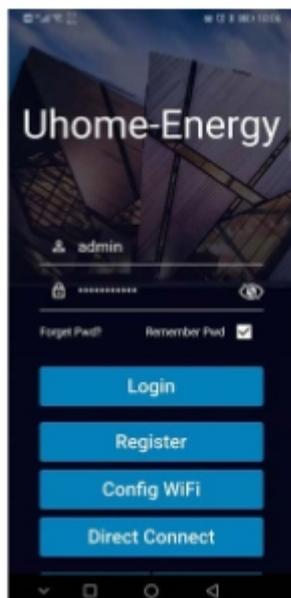

3. Search and select SSID connected and input the password,press 'Start Smart Config' and finish..



NOTICE

1. If the WIFI cannot be set or there is no WLAN accessible,the battery can still operate normally.
2. Default Multicast Mode , if fails, select to Broadcast Mode and restart the battery.
- 3.Scan QR code with you brower to view the configure wifi video.
- 4.If 2 batteries are configured at the same time, "Pack Count" selects 2.




Wifi Configuration

6.2 Register your account


NOTICE

The AOBOET Uhome battery could be registered only one time.

1. Open the APP monitor of battery, select , 'Register' option box.

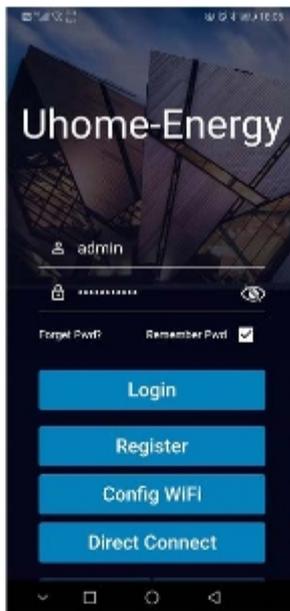


2. After scanning the bar code of battery, there are some personal messages need to be filled which noted.

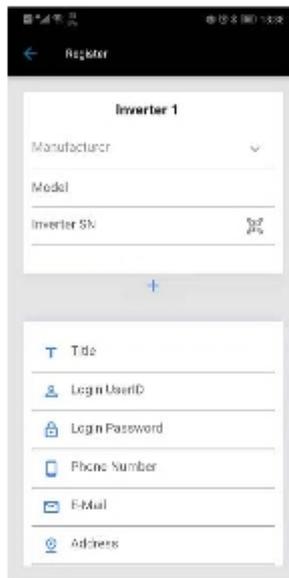

3. After those messages filled and signature, the APP would jump to the running interface automatically.

NOTICE
The AOBOET Uhome battery running is not associated with registration or not.

6.3 Settings for CAN /485 bus pins

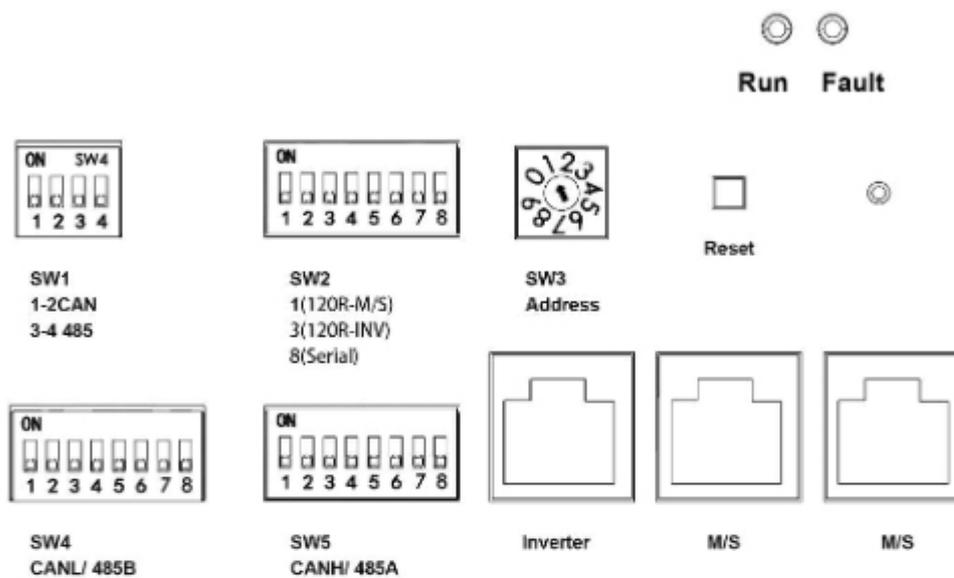

Confirm that the CANL/485B DIP switch is set to SW2 which pin is used for CAN high signal by inverter (4-CANH/485A), and the CANL/485B DIP switch is set to SW1 which pin is used for CAN low signal by inverter (5-CANL/485B).

As SW3 the CAN/485 GND DIP switch, installer should confirm which pin is used for ground by inverter or not.

NOTICE

The battery default protocol is CAN bus, if an inverter communication mode is RS485 or other protocol, please contact AOBOT hot line before installed the battery.

7. Commissioning

7.1 Commissioning battery

If there is only one battery installed, use the following steps to put it in operation:

1. Press and hold the panel button on the left side of the unit for about 4s, after the indicator lights on, release the panel button.
2. Make sure that the Run light is on. If it stays off, do not use the battery and contact AOBOET or your distributor.
3. Turn the inverter on, and wait for the start-up sequence to complete fully.

When there are two or more batteries connected with parallel mode, after the charging cable and the data cable has been connected correctly, follow these steps to put them in operation:

1. Check battery voltage level is above 48V
 - a) If battery voltage is under 45V contact your distributor or AOBET after service hot line for help.
2. Press and **HOLD** the panel button for about 4s, after four seconds the indicator lights will turn on.
3. Release the panel button.
 - a) For all batteries, make sure that the Run light is on.
 - b) Make sure the maximum voltage different between batteries less than 1.0V.
 - c) If not, the installer should balance the battery voltage and then parallel connect batteries together.
 - d) Set the DIP switches like part **6-1 Setting for communication interface**.
4. Turn the inverter on, and wait for the start-up sequence to complete fully.



7.2 Shut down battery

Shut down the battery only when the battery is no charge or discharge current which could be seen in your smart phone with APP.

1. Press and hold the Panel Button about 8s, after a disconnect voice of relay come can release it.
2. Make sure that every light on the battery is off.

8. Firmware Update

It is able to upgrade the BMS firmware version remotely and check the upgrading real time status through the WIFI monitor system App.

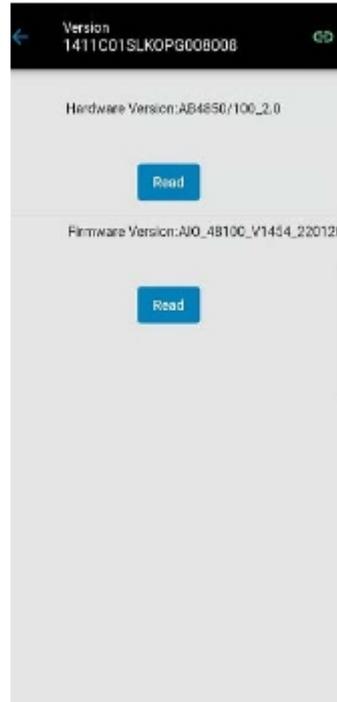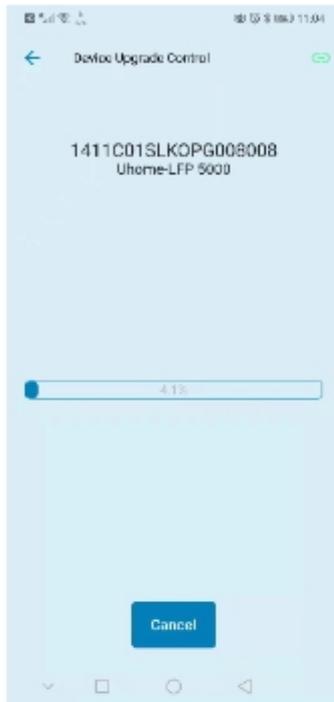

AOBOET

Our Environment, Our Energy, Our Future



Manufacturer : AOBO Environmental New Energy (Wuxi) Co., Ltd.

Address: Sumiao Village, Qianqiao Street, Huishan District, Wuxi City (Industrial Concentration Zone)

Phone number: 86-510-85366880

E-mail: info@aoboet.com.au

www.aoboet.com.au